NOTE:
The Main Extract stack is expected to remove 1.70m3/s od air from the labs (Please note acid fumes have been removed completely from this extract system)

The MD Extract stack is expected to remove 0.49m3/s of air from the labs. (Please note acid fumes are scrubbed (98% Efficiency))

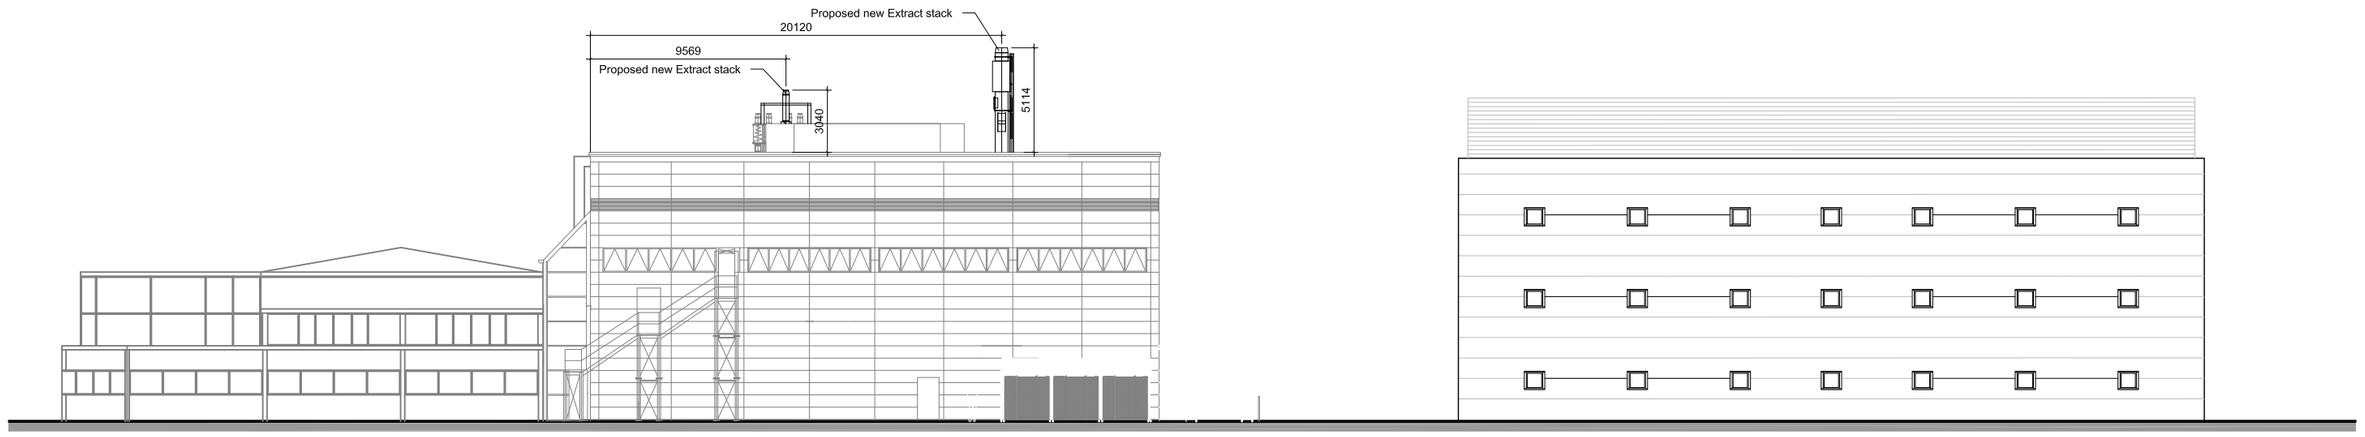

TC2 Proposed East Elevation

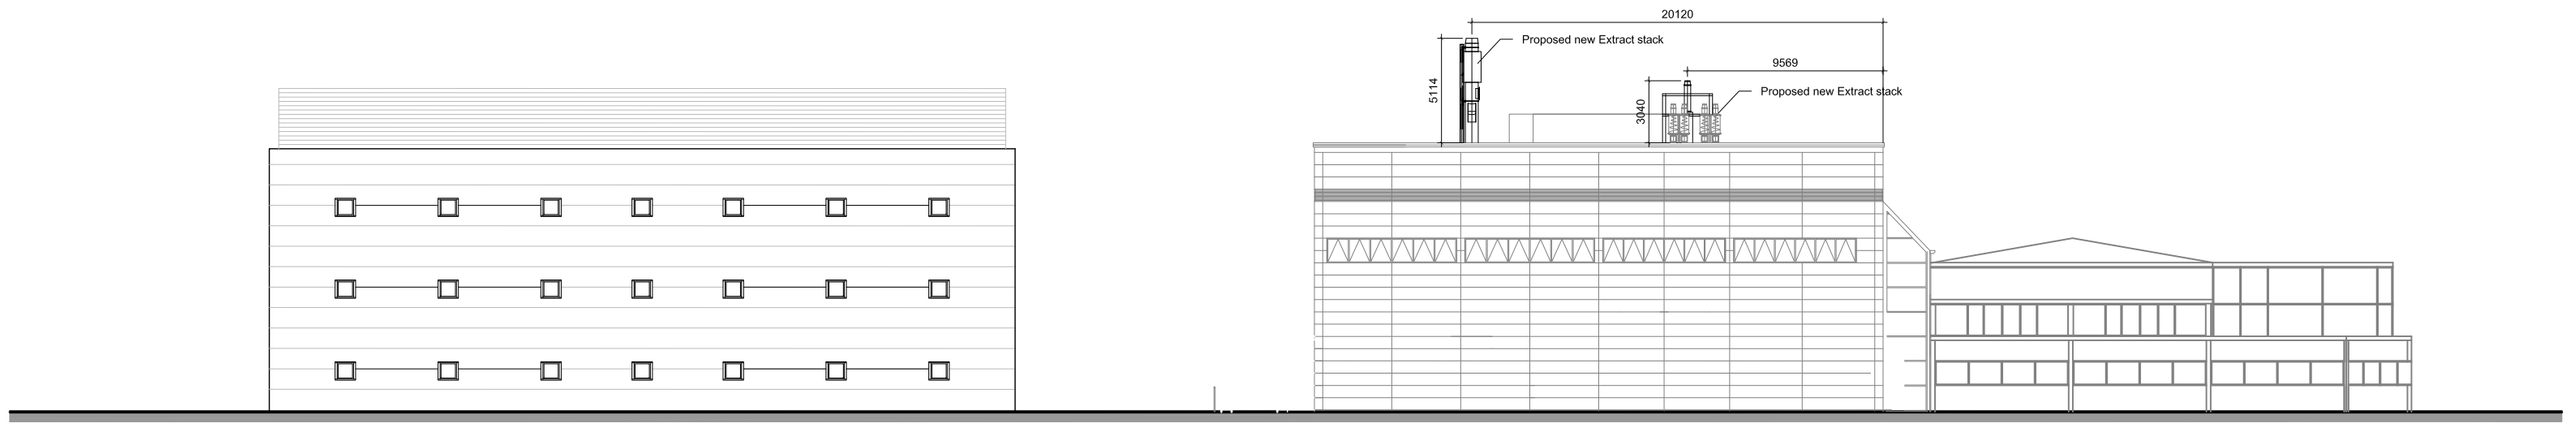

TC2 Proposed West Elevation

drawing status: **Planning**

client:
Johnson Matthey
Royston
Hertfordshire

drawing originator:

BERTRAM DONE
Paragon House
48 Seymour Grove
Manchester M16 0LN
T 0161 873 9390
F 0161 873 7164
E mail@bertramdone.co.uk
I www.bertramdone.co.uk

THIS DRAWING IS THE PROPERTY OF BERTRAM DONE & PARTNERS AND MUST NOT BE COPIED OR REPRODUCED EITHER IN WHOLE OR IN PART WITHOUT PRIOR WRITTEN PERMISSION

mark	date	details	by	chkd

project title:
TC2 Extract Stacks

drawing title:
Proposed Elevations

scale: 1:300 — for original drg size of A2

drn by: MH	chkd by: AE	psd by:	date: March '18

job no:	drawing no:	revision:
825	P2	/