



Crate information
(refer to engineering drawings for further information)

Reference	Size	Depth	Volume	Min. Cover level	Invert	Notes
SA-01	38.5m'	0.4m	14.63m³	82.375	81.225	
SA-02	44m'	0.4m	16.7m³	84.200	81.700	
SA-03	24.5m'	0.8m	18.62m³	85.050	83.350	
SA-04	36m'	0.4m	13.68m³	84.500	82.730	
SA-05	52m'	0.4m	19.76m³	81.570	80.570	
SA-06	52m'	0.4m	19.76m³	81.470	80.570	
SA-07	52m'	0.4m	19.76m³	81.360	80.300	
SA-08	72m'	0.4m	27.36m³	80.300	79.080	
SA-09	72m'	0.4m	27.36m³	76.300	74.700	
SA-10	51m'	0.4m	38.76m³	73.800	71.600	
SA-11	12m'	0.8m	9.12m³	74.660	72.100	

Please refer to table for relevant depth of each tank.

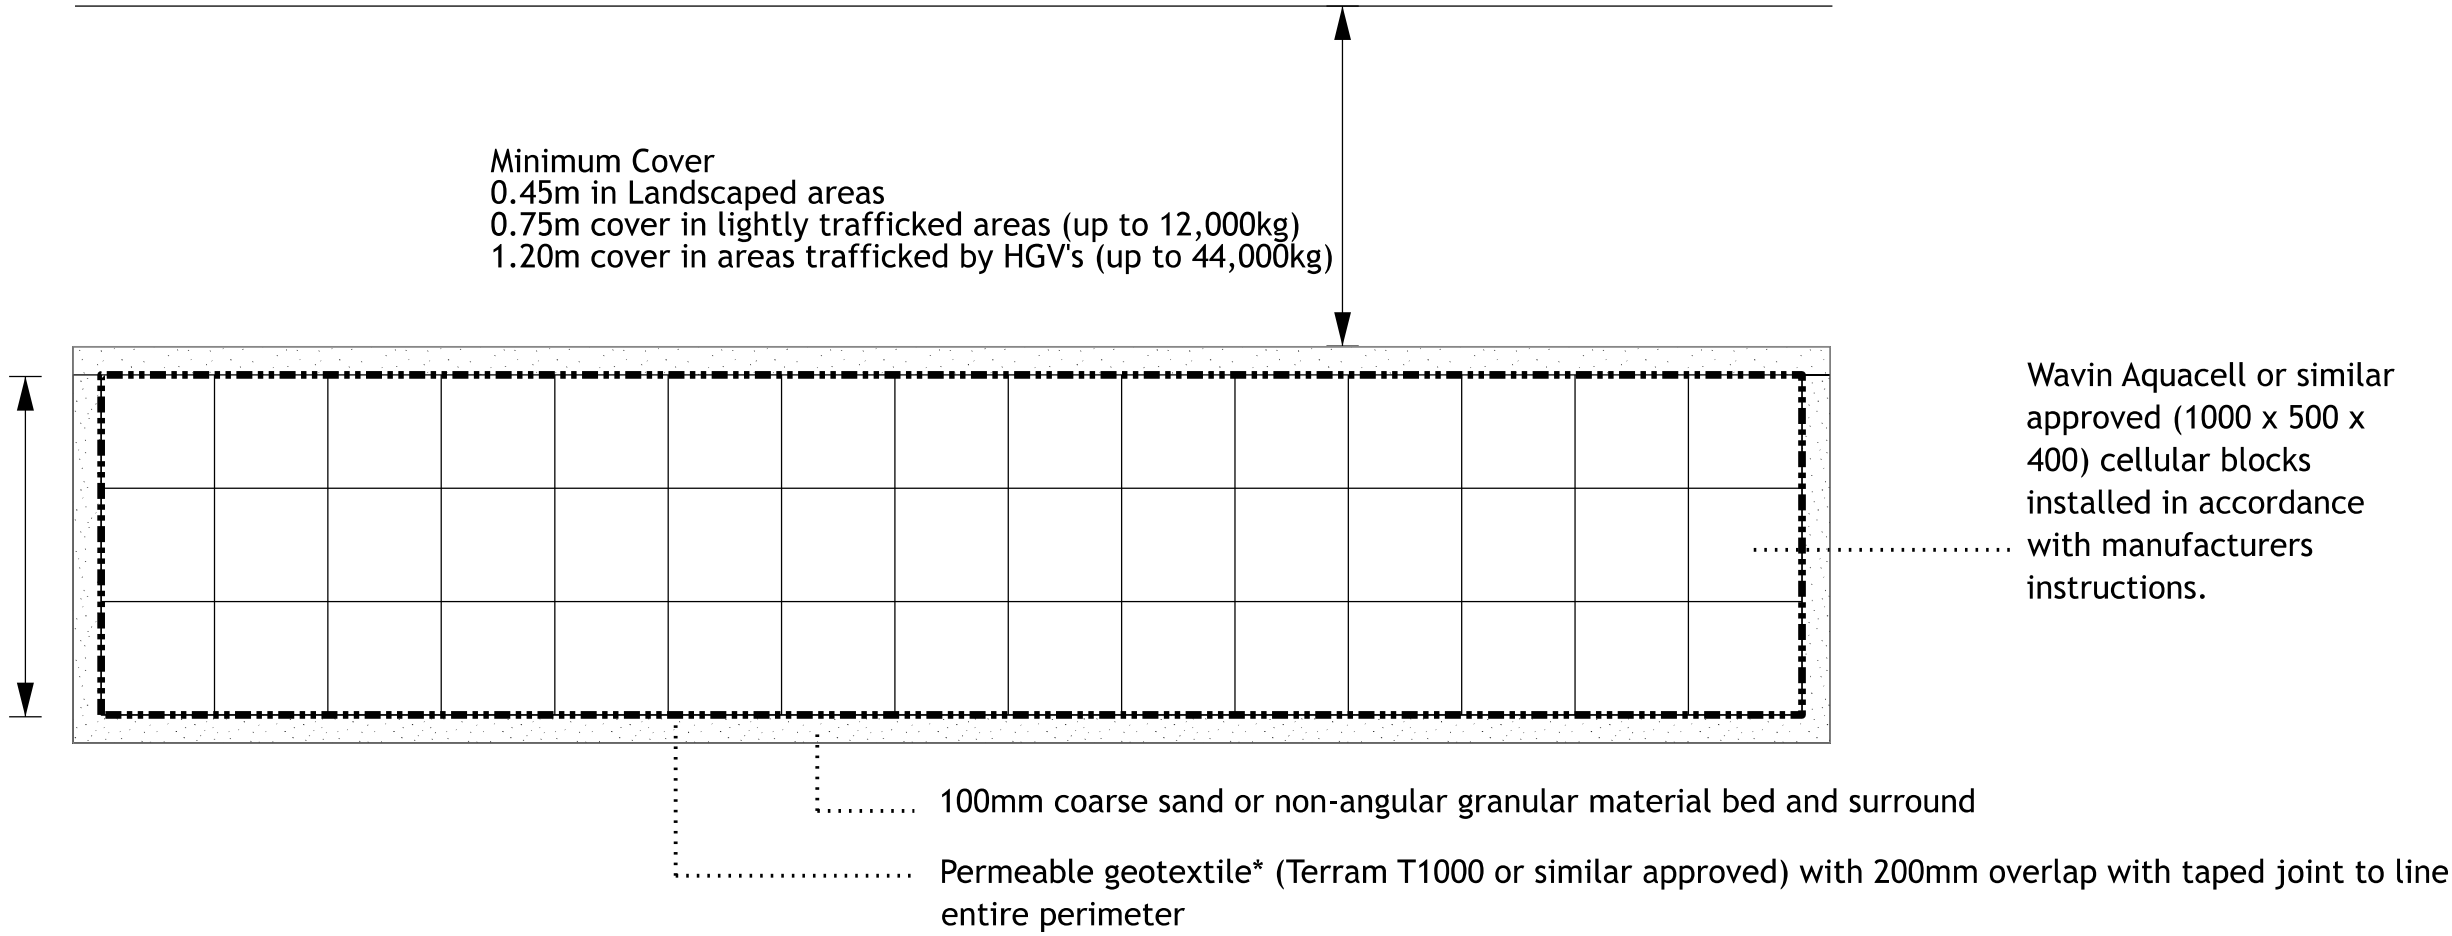

Typical geocellular infiltration crates detail

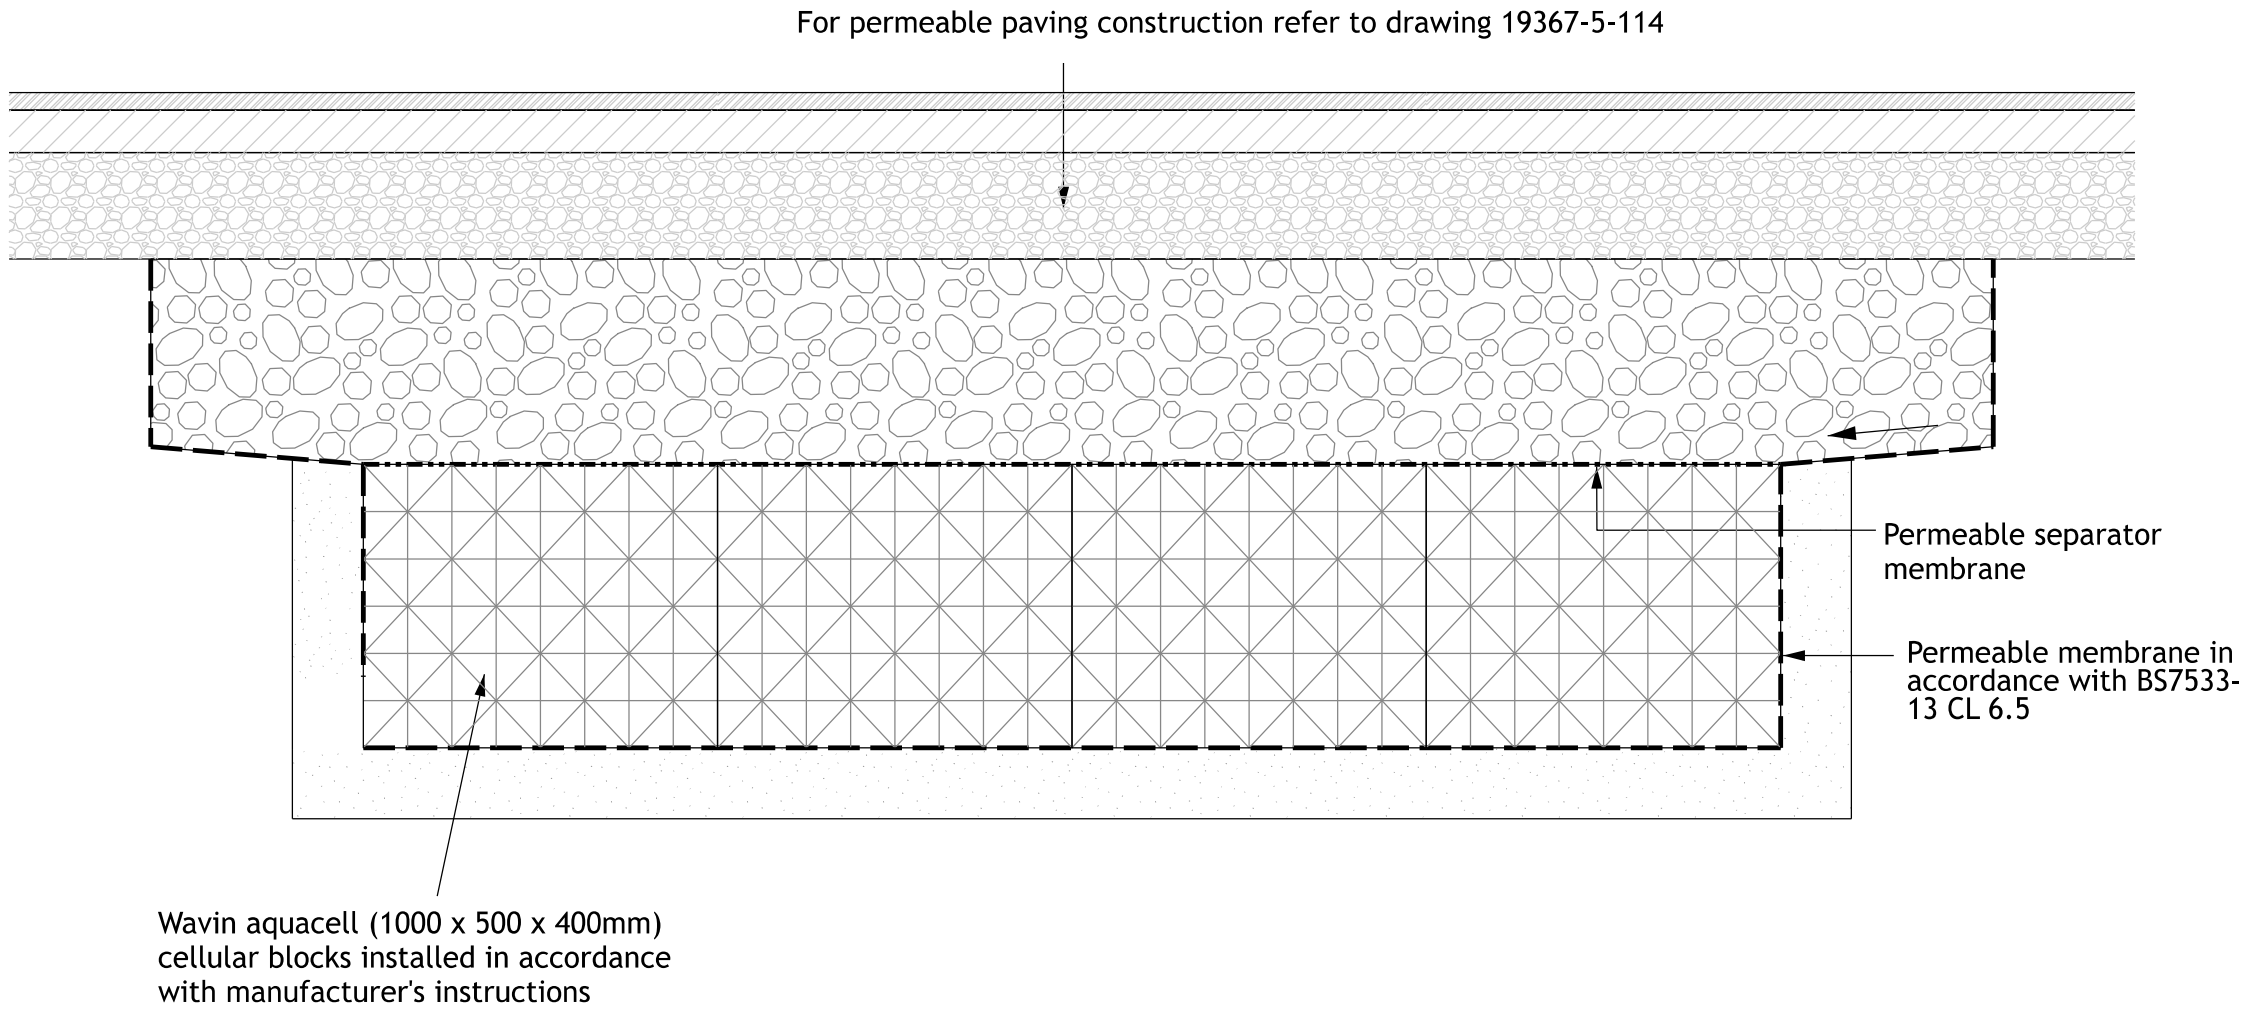

NOTES

- Contractors must check all dimensions on site. Only figured dimensions are to be worked from. Discrepancies must be reported to the Architect or Engineer before proceeding. © This drawing is copyright.
- All plans and drawings are drawn true to stated scales and can be used for the purpose of planning only. Responsibility is not accepted for errors made by others in scaling from this drawing.
- Until technical approval has been obtained from the relevant authorities, all drawings are issued as preliminary and not for construction. Should the Contractor commence site work prior to approval being given it is entirely at their own risk.
- Attenuation crates to be installed in accordance with manufacturer's instructions and guidance.

- Refer to engineering drawings for storage crate sizings, locations and additional information.

SAFETY, HEALTH AND ENVIRONMENTAL

In addition to the hazards, risks normally associated with the type of work detailed on this drawing, note the following significant risks and information.

Construction:

- There is a moderate risk of asbestos being present on site. An asbestos survey should be undertaken with all identified asbesto to be disposed safely to a licenced tip.
- Works are in or adjacent to live highways and construction traffic.
- The Contractor should make all necessary enquiries and take all necessary measures to identify the location of existing utilities and take relevant precautions.

For information relating to end use, maintenance, demolition, see the health and safety file.

It is assumed that all works will be carried out by a competent Contractor, where appropriate, to an approved method statement.

D	Soakaway sizes revised following LLFA comments	SHD	SD	11.06.2024
C	Revised soakaway levels	SHD	SD	25.03.2024
B	Cellular soakaway notes updated	SHD	SD	24.01.2024
A	Revised to suit amended drainage levels	SHD	SD	17.11.2023

REV	DESCRIPTION	DRN	CHD	DATE
-----	-------------	-----	-----	------

- ☒ PRELIMINARY ☐ INFORMATION ☐ TENDER
- ☐ CONSTRUCTION ☐ AS BUILT

SCALE	N.T.S @ A2	DATE	NOVEMBER 2023
-------	------------	------	---------------

DRAWN	SD	CHK	SD
-------	----	-----	----

DRAWING NO.	19367-OAKL-5-900	REV	D
-------------	------------------	-----	---

TITLE	OAKLEIGH MEADOWS WELWYN
-------	----------------------------

DETAILS	STORAGE CRATE DETAILS
---------	-----------------------