


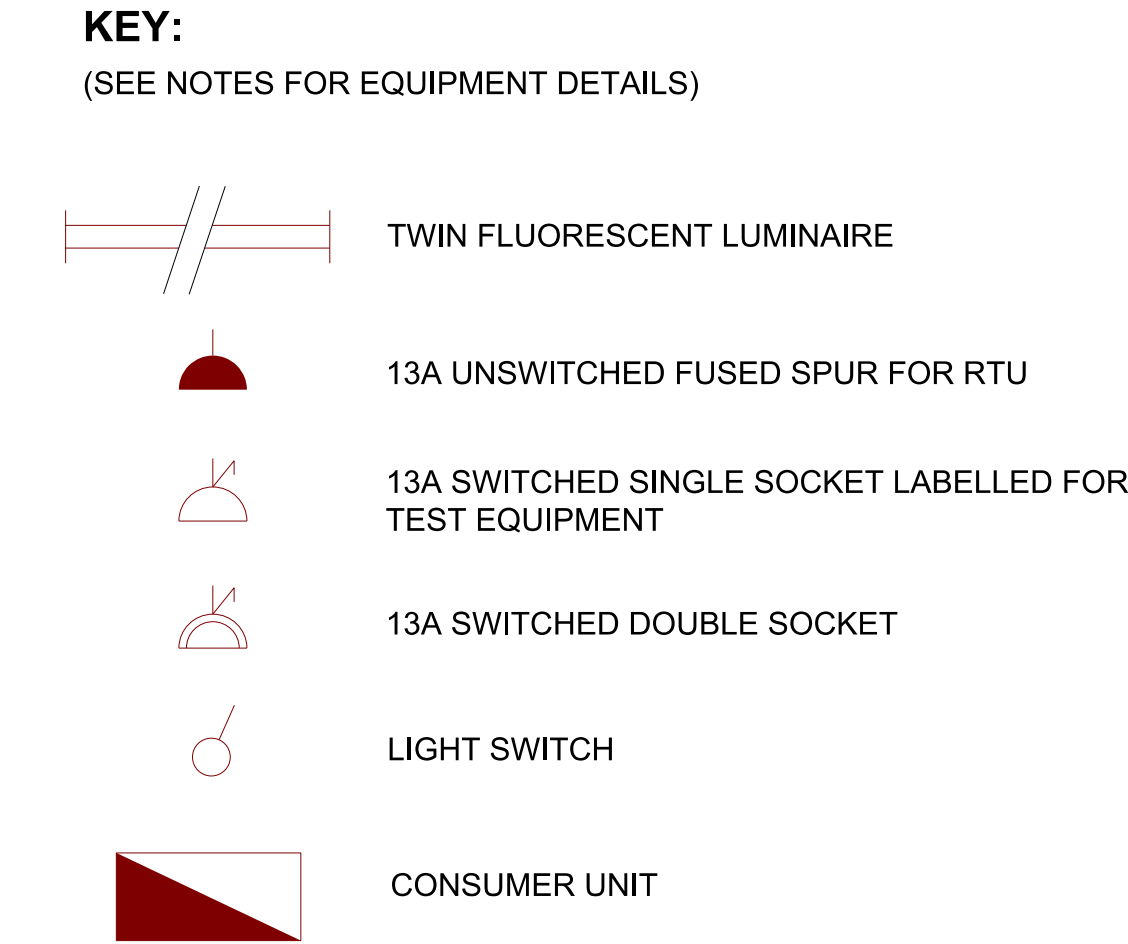

- TESTING AND CERTIFICATION**
- UPON COMPLETION OF THE WORKS, THE INSTALLATION SHALL BE TESTED IN ACCORDANCE WITH BS 7671, AN ELECTRICAL INSTALLATION CERTIFICATE TOGETHER WITH A SCHEDULE OF TEST RESULTS AS DETAILED IN BS 7671 SHALL BE FORWARDED TO UK POWER NETWORKS.

			
TITLE UNIT OR PADMOUNT SUBSTATION IN A GRP ENCLOSURE SMALL POWER & LIGHTING			
SCALE NTS	@A1	APPROVED	Version A
DRAWING NO. EDS 37-3102.01 Sht 3 of 3			
SITE		SECONDARY SITES	