
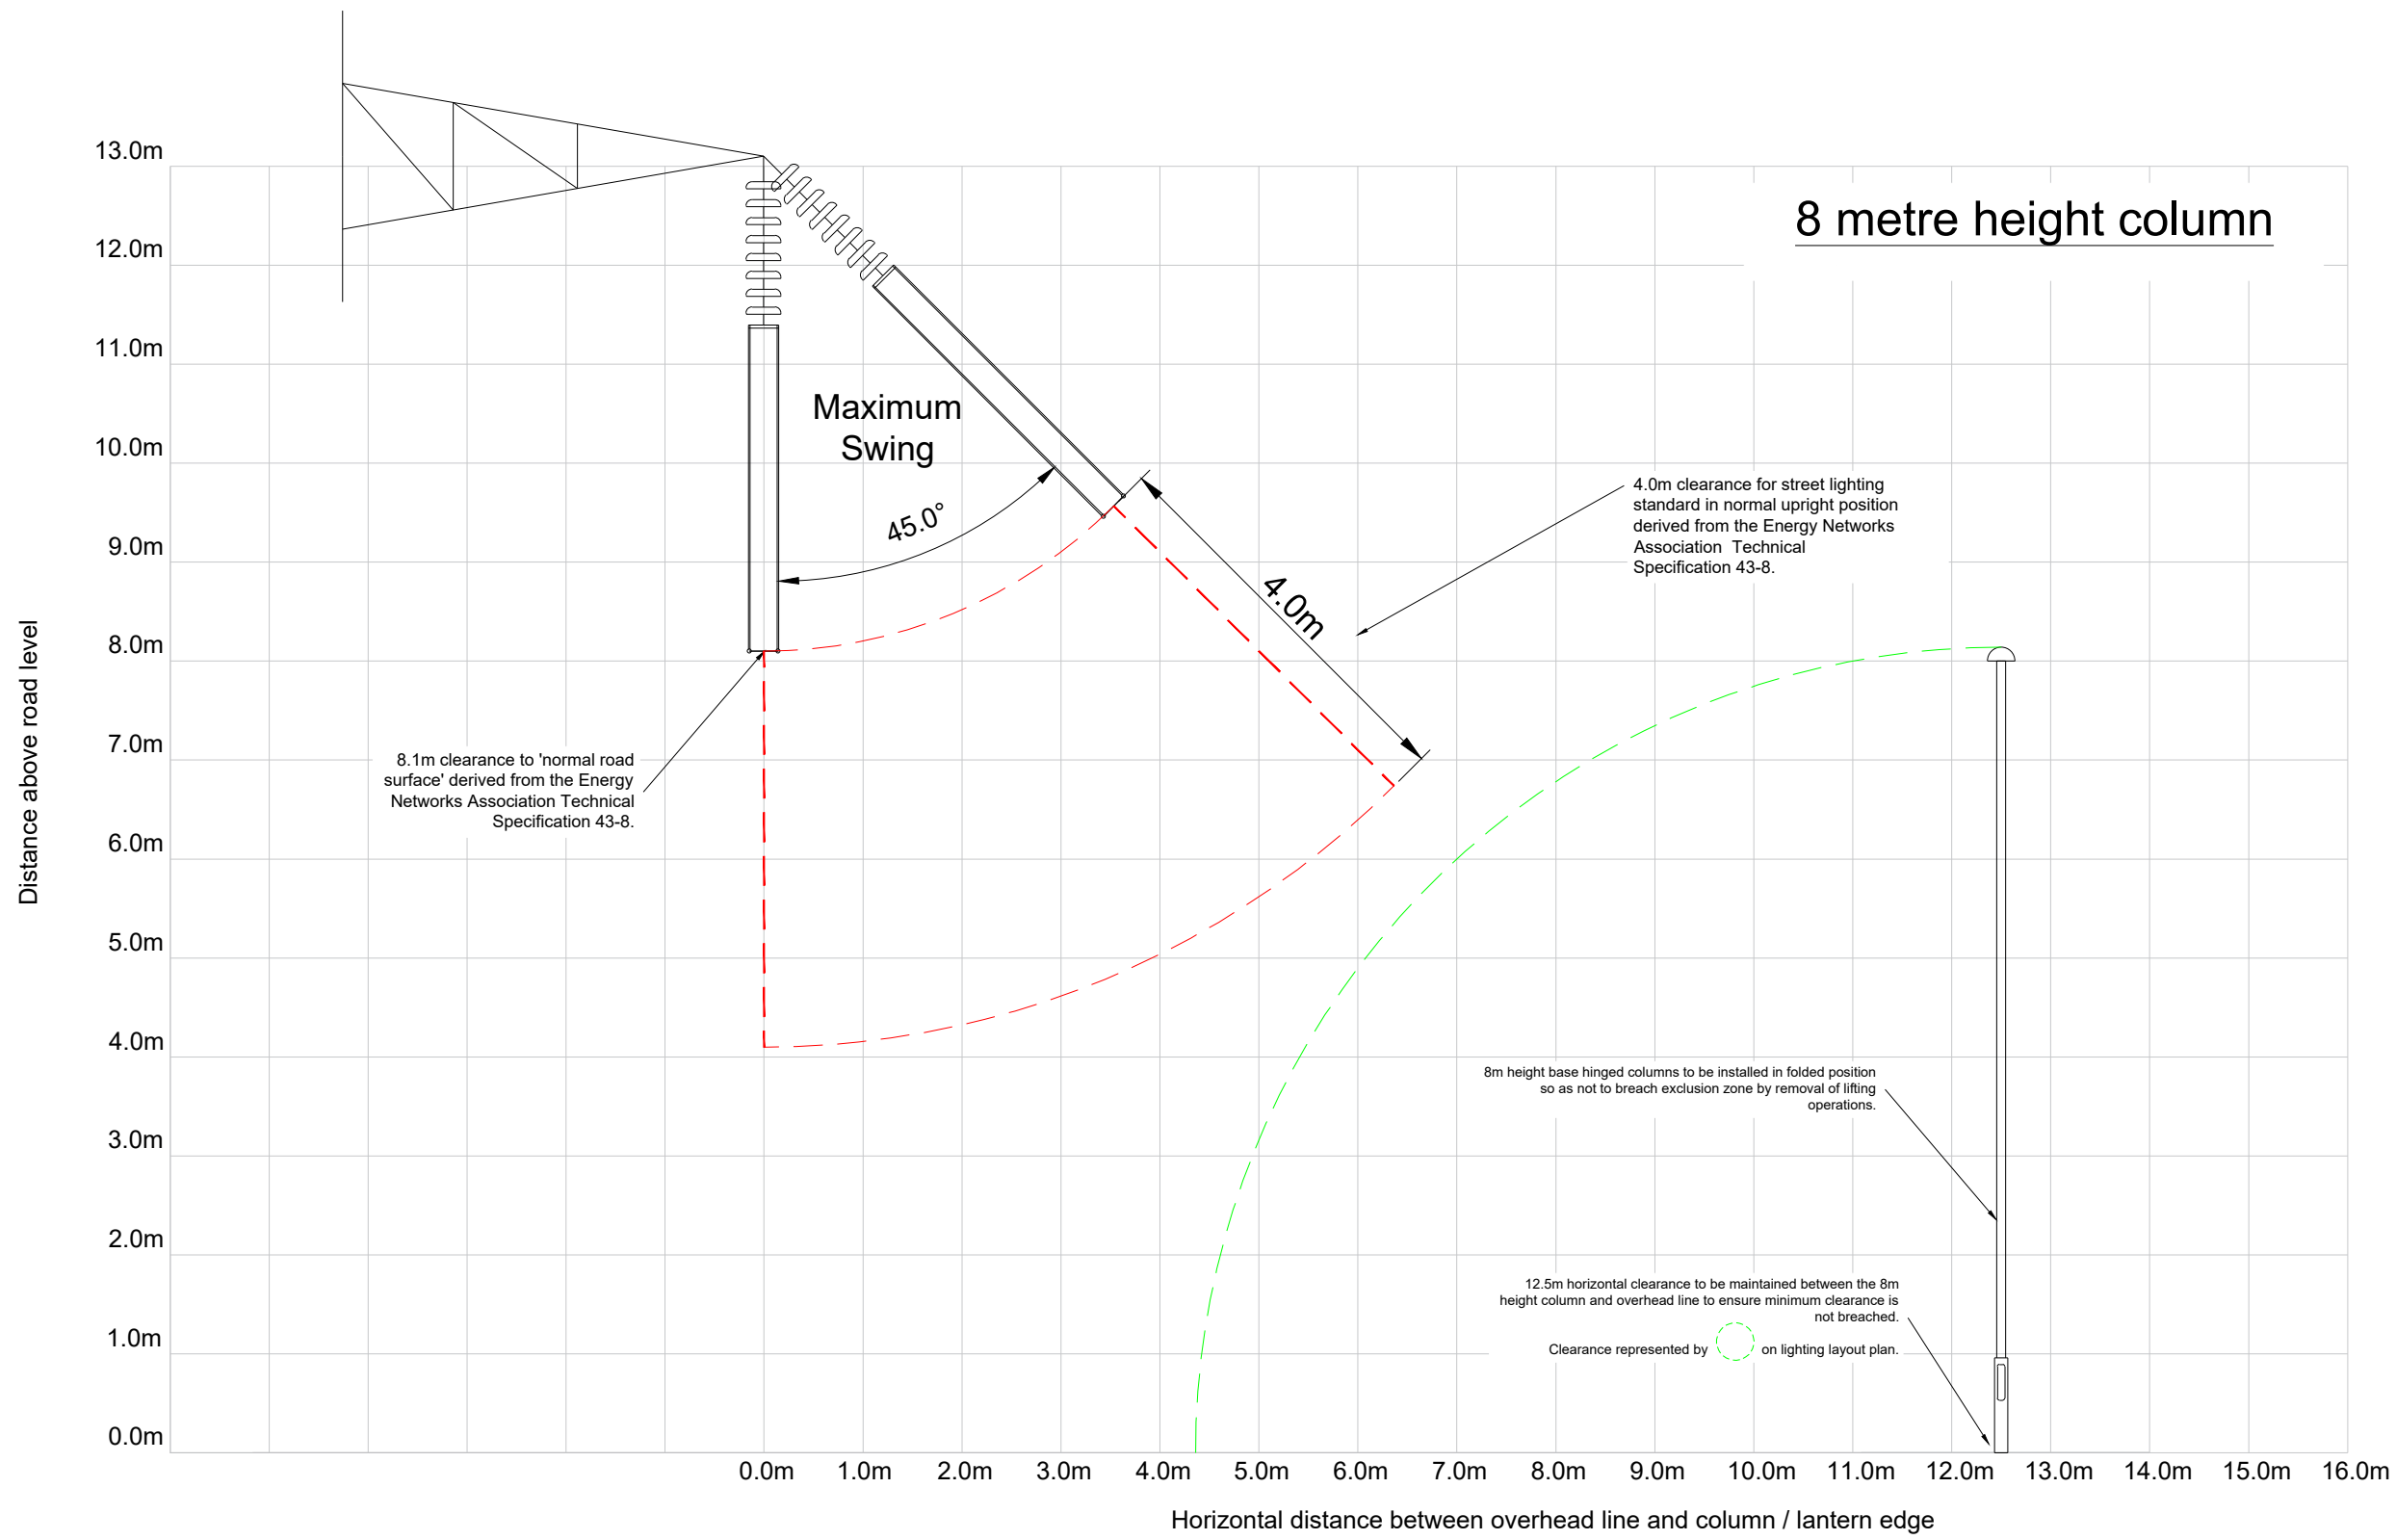




PLEASE ALSO REFER TO THE FOLLOWING GUIDANCE DOCUMENTS:

- Energy Networks Association Technical Specification 43-8 Issue 5
- National Grid Technical Guidance Note 287 - Third-party guidance for working near National Grid Electricity Transmission equipment
- National Grid overhead line profile drawing 4TB001A-074_13714_A
- UKPN overhead line profile drawing 099-EPN-DR-8430059315-88-000 R1

Diagram to illustrate the safety clearances for National Grid 400kV overhead lines

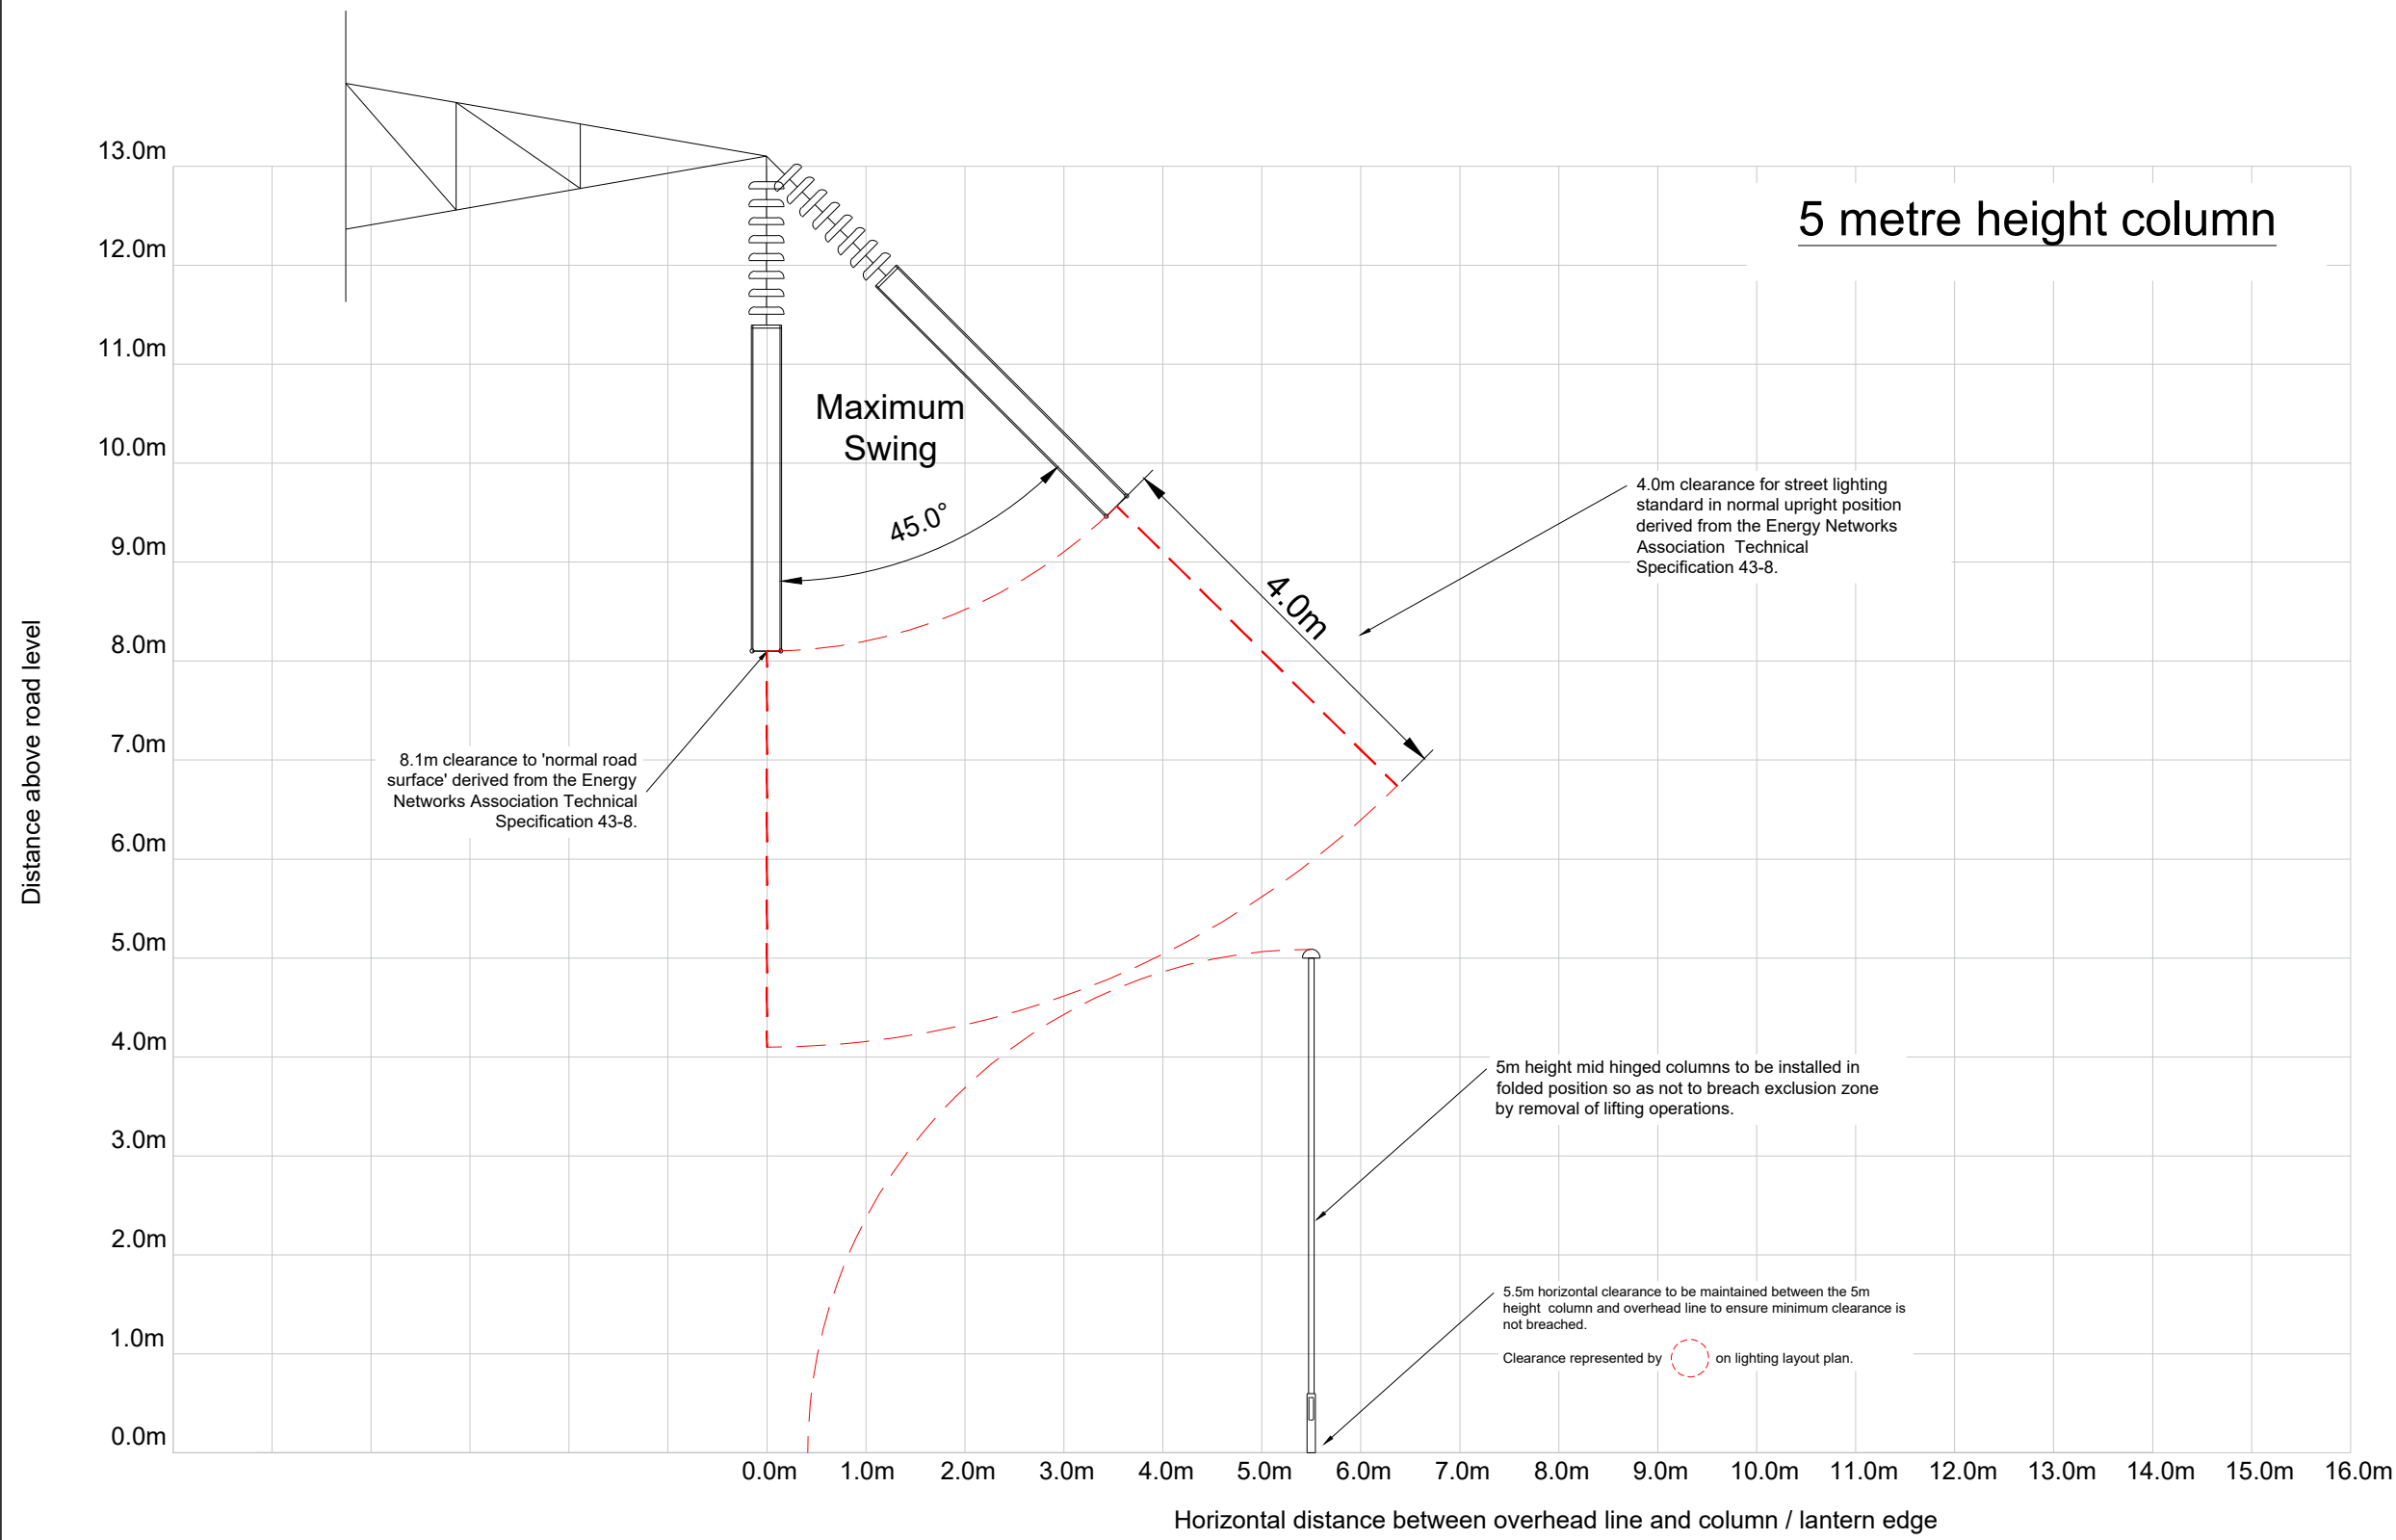

Diagrams to illustrate the safety clearances for UKPN 132kV overhead lines

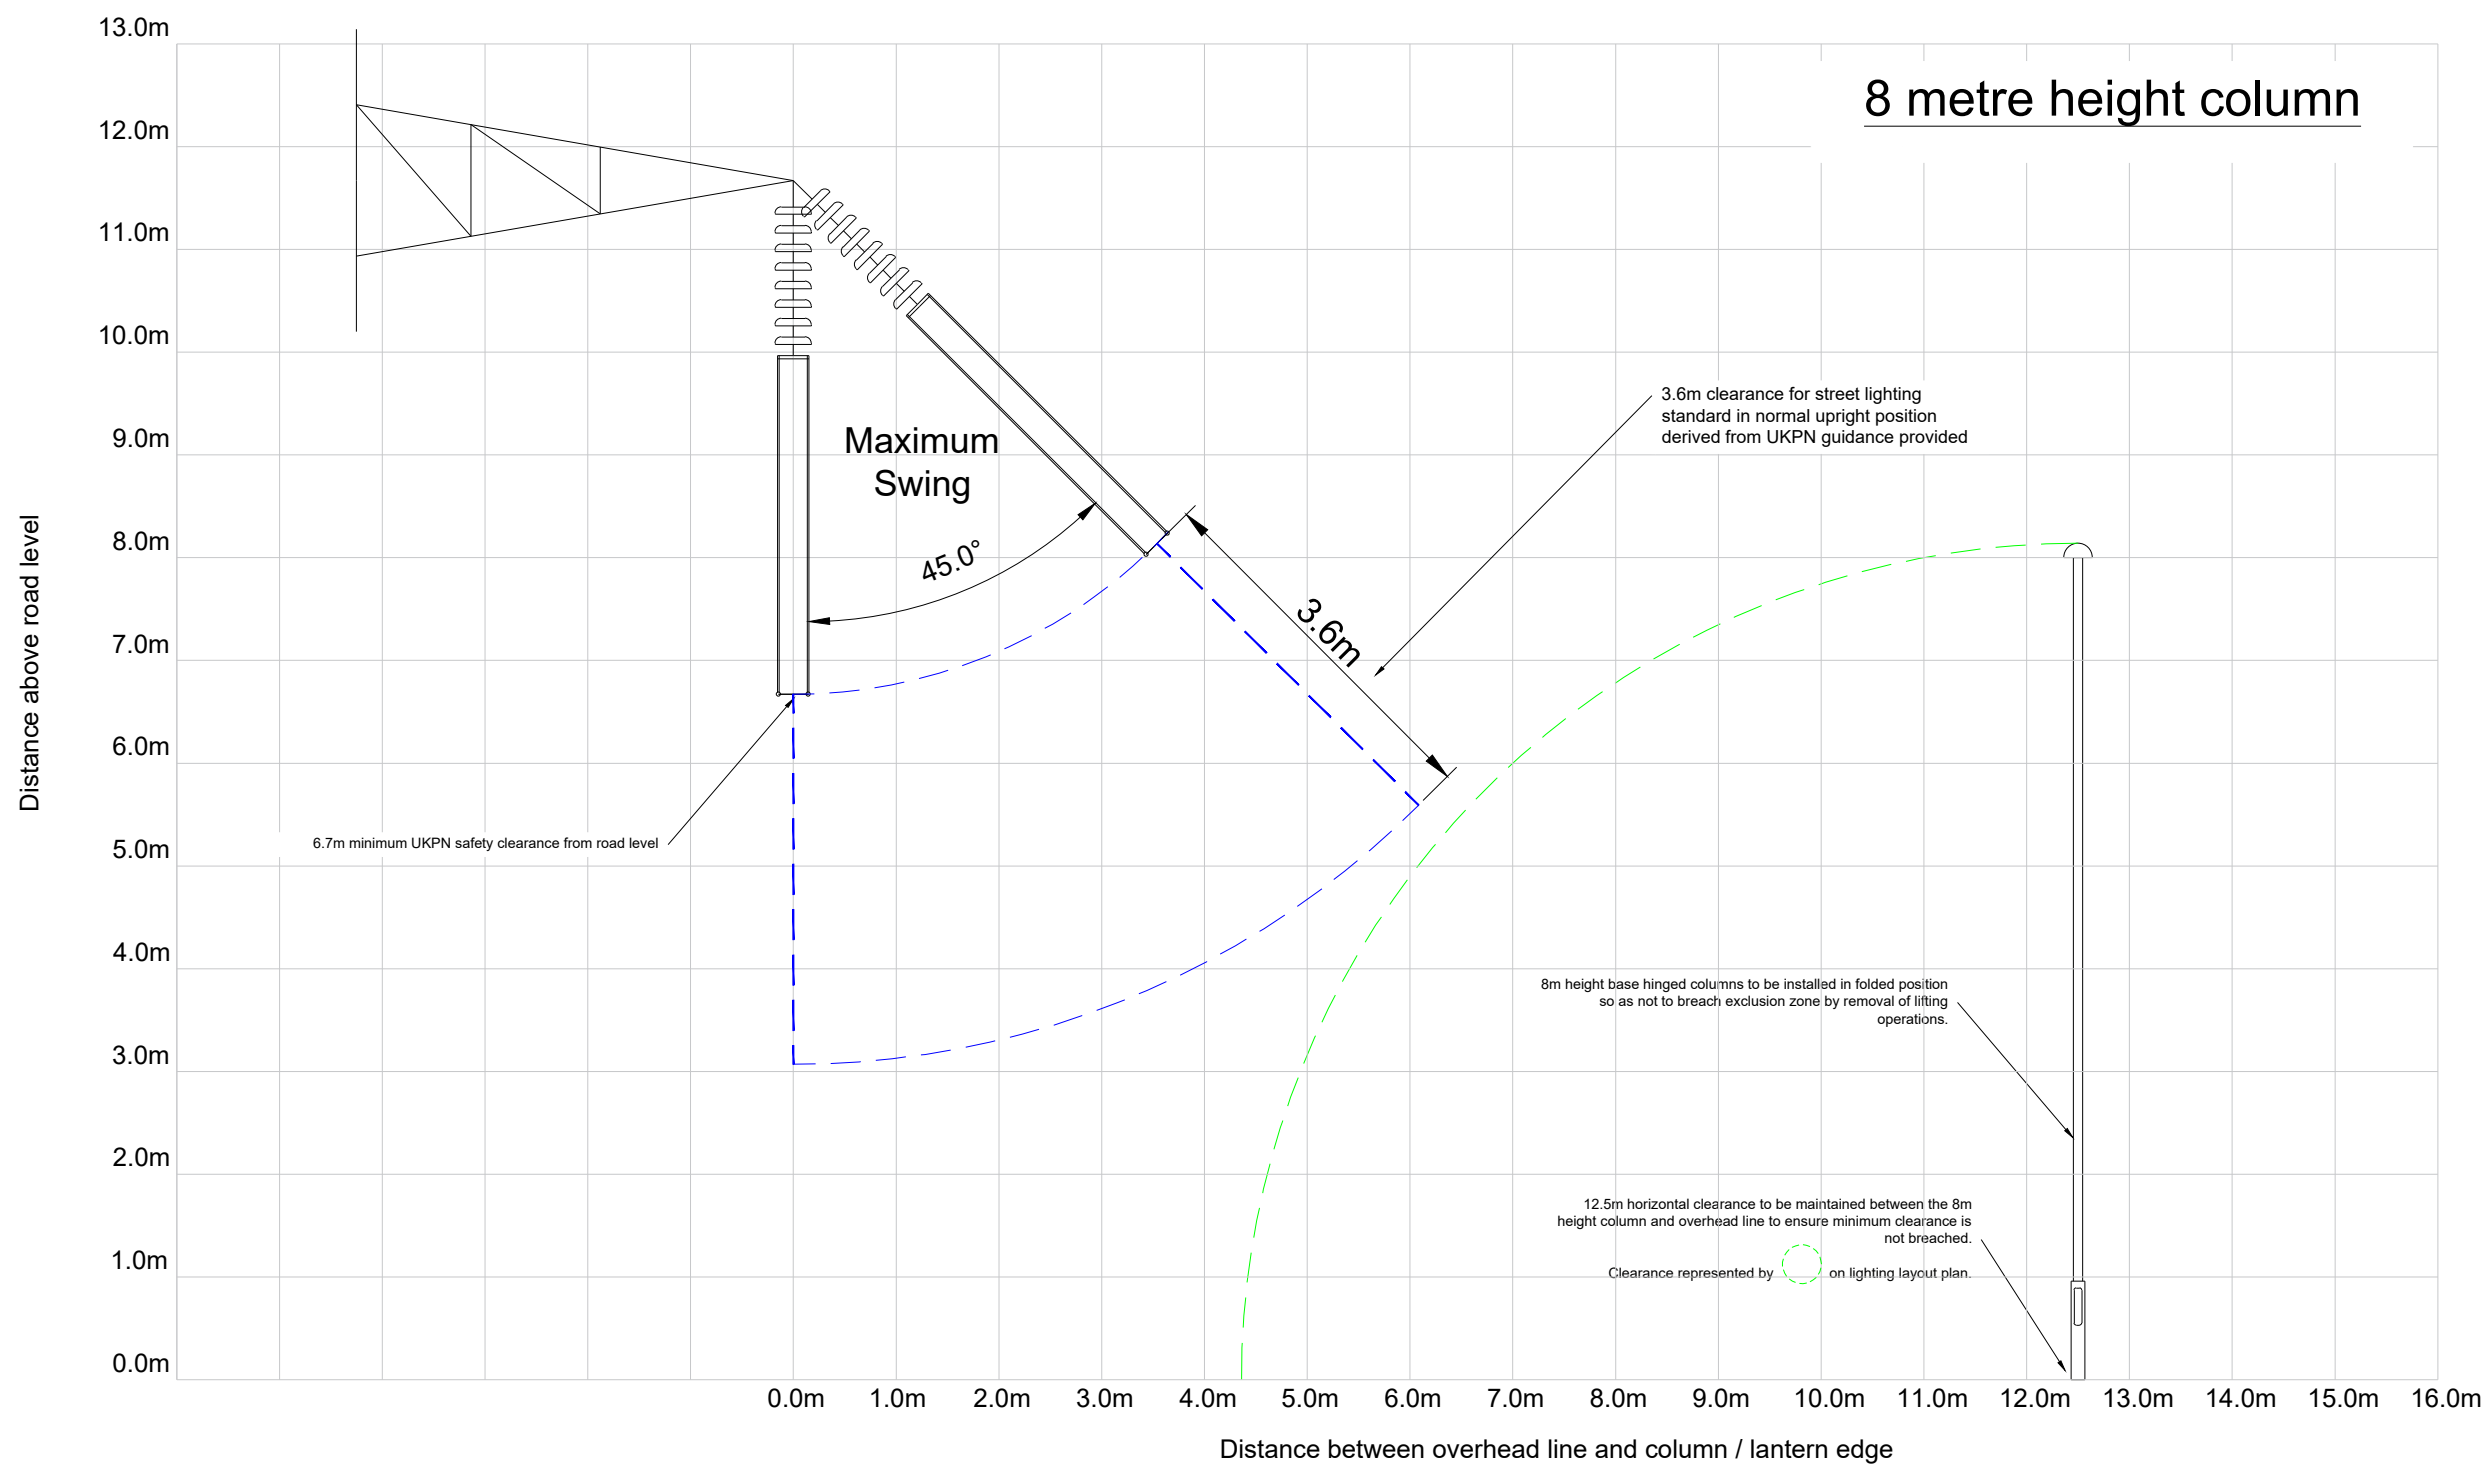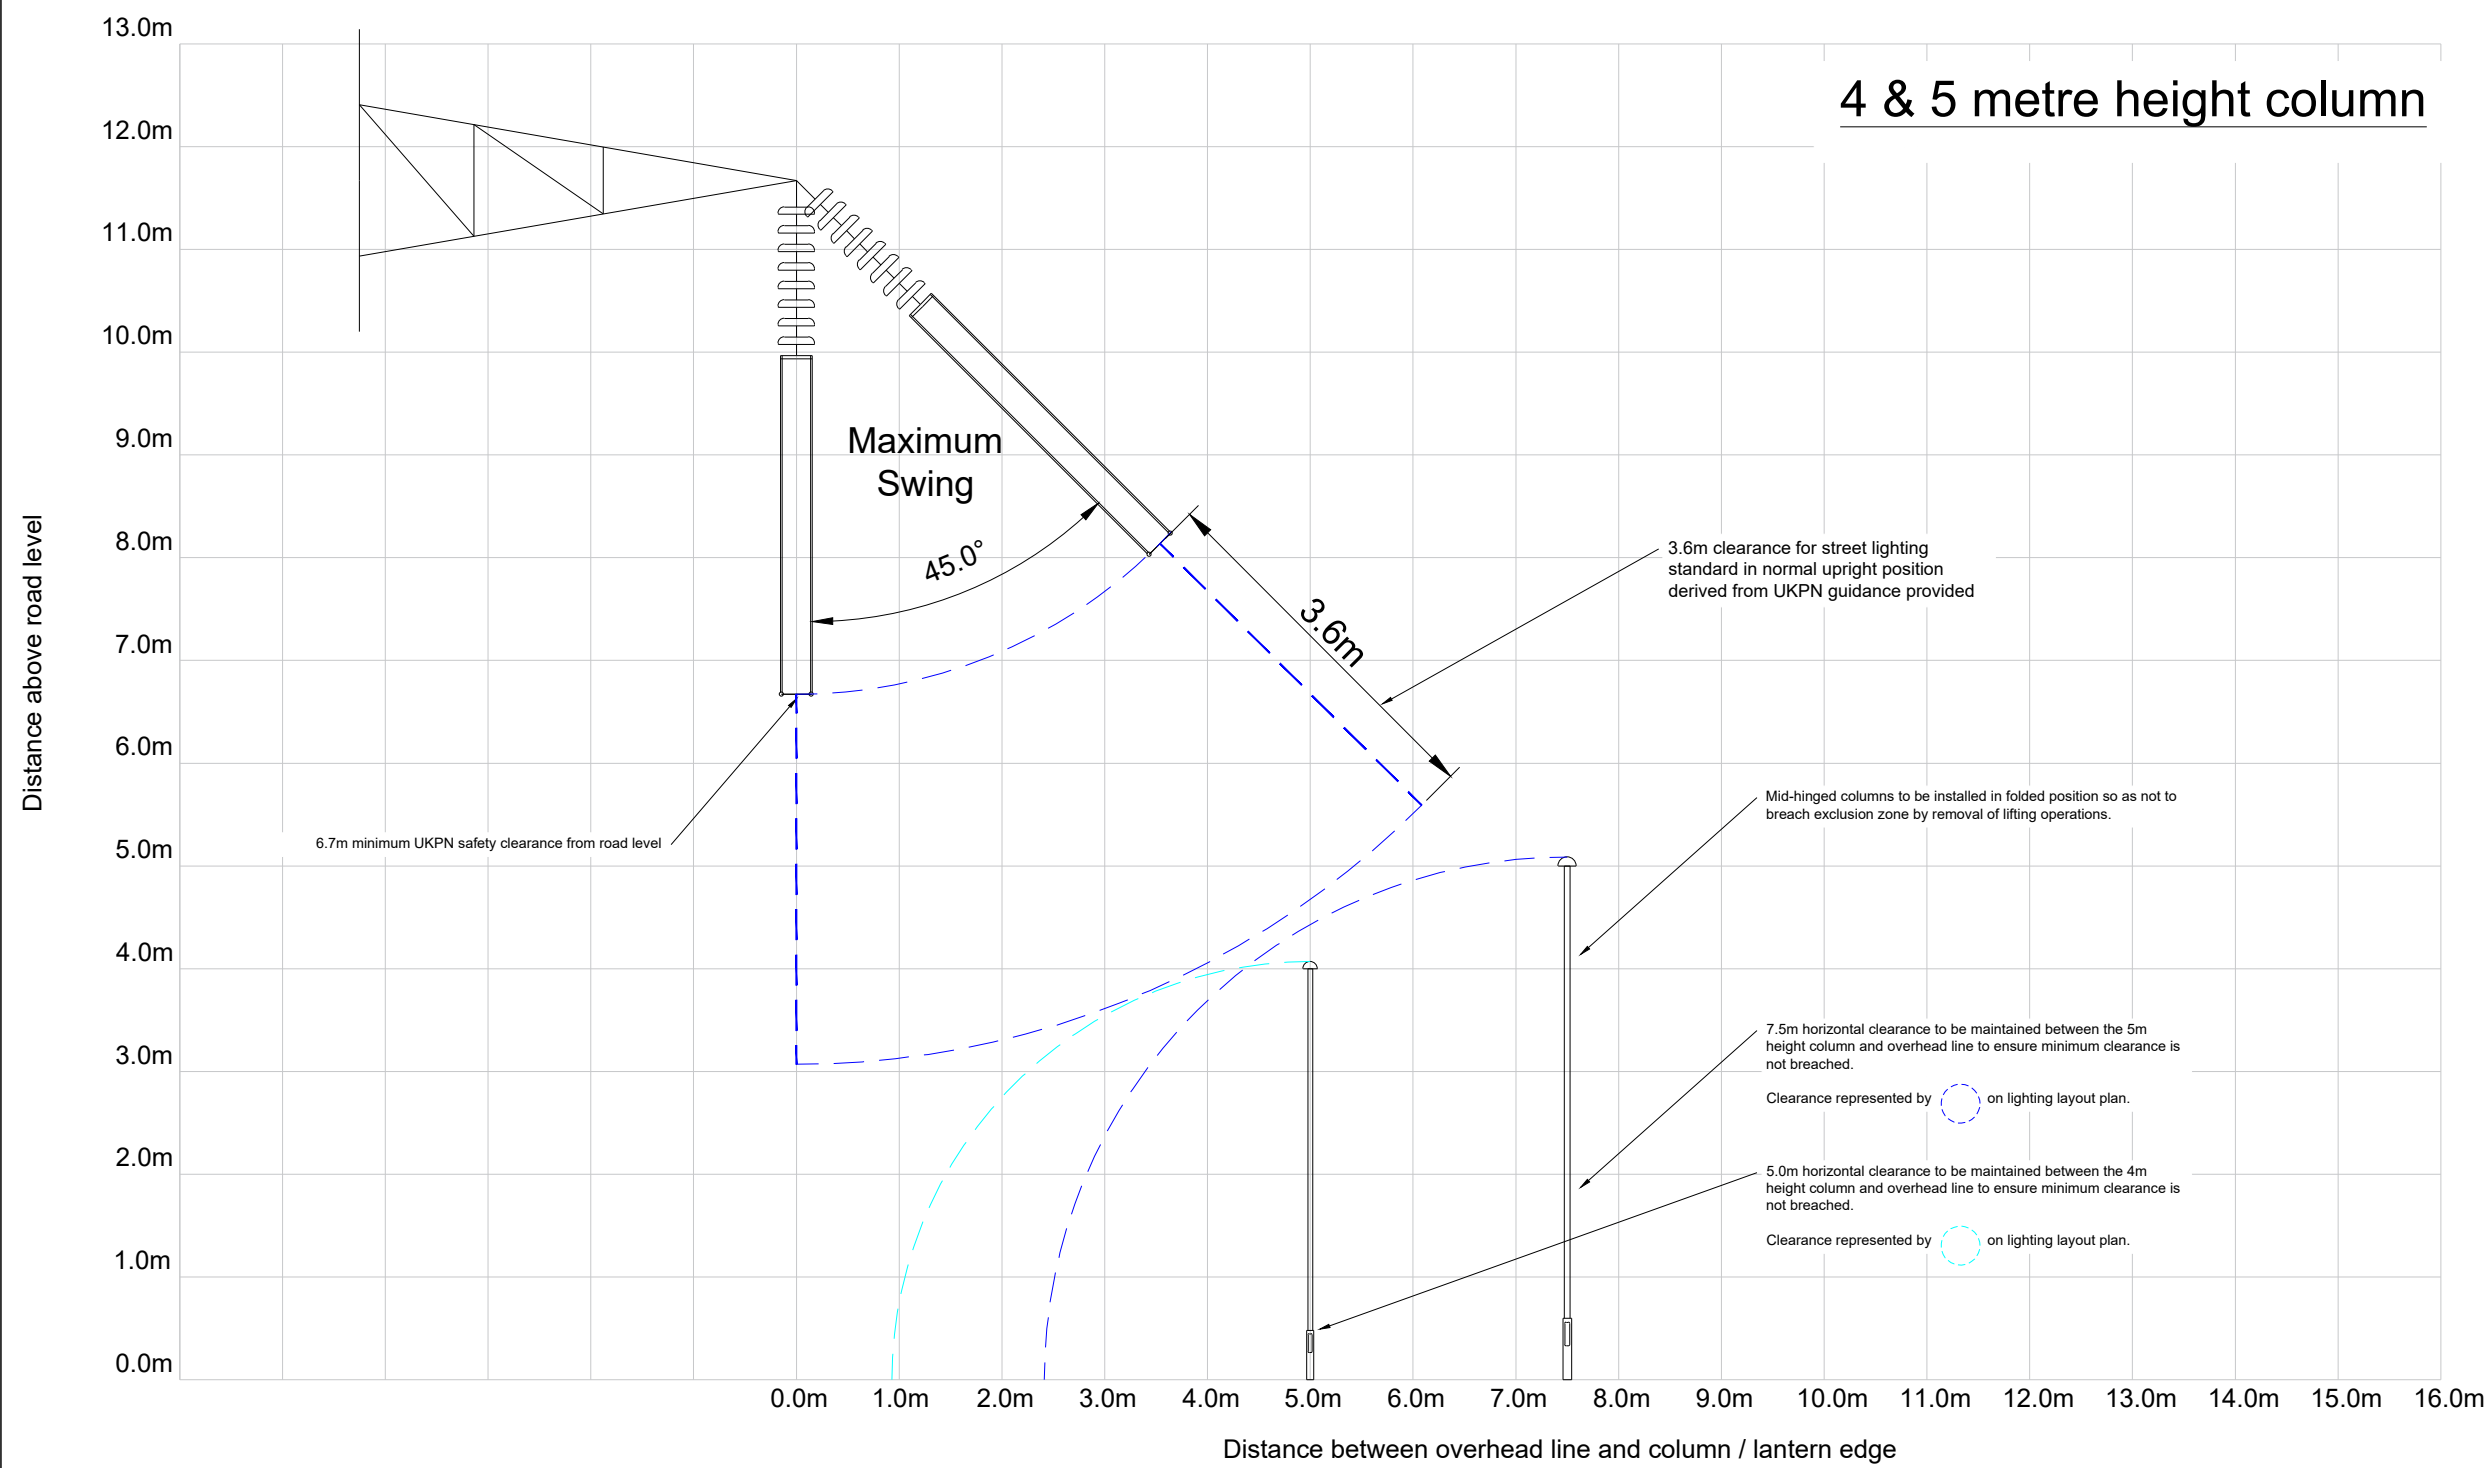

GENERAL NOTES:
1. THIS DRAWING HAS BEEN PRODUCED TO DEMONSTRATE THE OVERHEAD CLEARANCES BASED ON GUIDANCE PROVIDED BY UKPN & NATIONAL GRID.

P03	JJ	JJ	03.10.2025	4M HEIGHT COLUMN DETAIL ADDED
P02	JJ	JJ	22.04.2025	NATIONAL GRID CLEARANCES ADDED
P01	JJ	JJ	17.04.2025	FIRST ISSUE
REV	DRN	DES	DATE	DESCRIPTION

joseph lighting

www.josephlighting.co.uk

Client

PICTURE ESTATES LTD

Project

GREAT ASHBY
MAIN ACCESS

Title

OVERHEAD LINE CLEARANCES
SHEET 2 OF 2

Scale NTS	Drawn JJ	Design JJ	Created 08.04.2025
Drawing No. 100730-JLD-ASH-DR-0002	Revision P03		
Status FOR PLANNING	Sheet Size A1		