



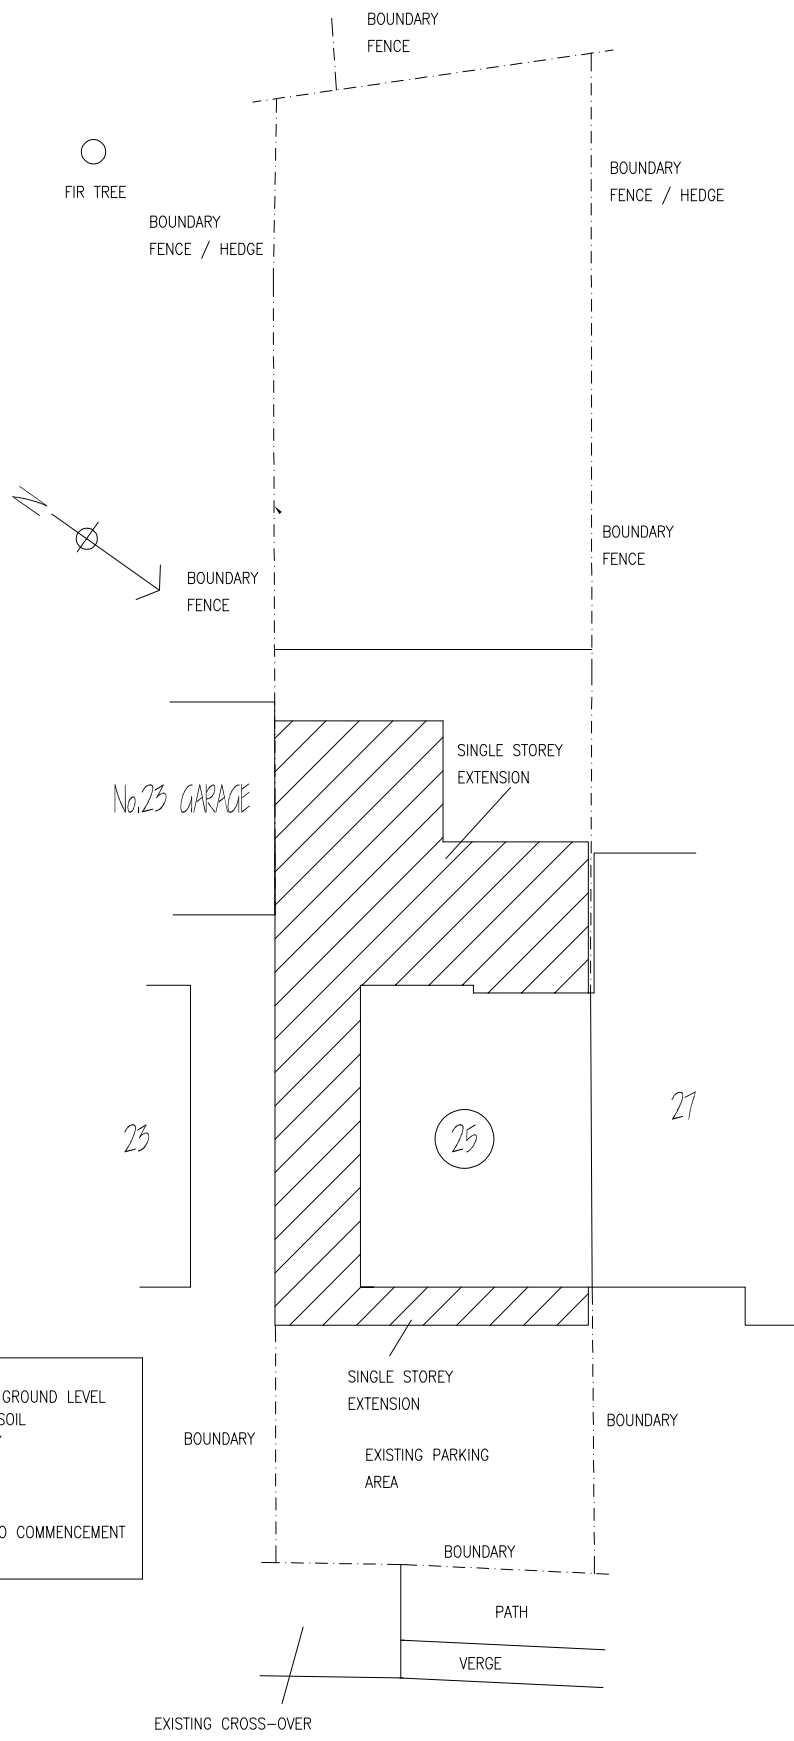

FOUNDATION DEPTHS
 ALL FOUNDATION DEPTHS ARE TO BE 1.05m MIN FROM EXISTING GROUND LEVEL
 TREES ARE CALCULATED AT MATURE HEIGHT IN HIGH SHRINKAGE SOIL
 USING NHBC STANDARDS (CHAPTER 4.2) THEREFORE INVERTS MAY
 BE HIGHER THAN STATED.
 ALL EXCAVATIONS TO BE CHECKED BY BUILDING INSPECTOR
 PRIOR TO POURING CONCRETE
 TREE SPECIES AND POSITIONS TO BE CHECKED ON SITE PRIOR TO COMMENCEMENT
 AND AGREED WITH THE BUILDING INSPECTOR

B ELEVATED PATIO REMOVED 04/02/25
 A STEPS REVISED 23/DEC/24



SITE PLAN
 1:200