


○ TREE

○
FIR TREE
(FOUNDATION 1.05m)


○
FIR TREE
(FOUNDATION 1.05m)

FOUNDATION DEPTHS

ALL FOUNDATION DEPTHS ARE TO BE 1.05m MIN FROM EXISTING GROUND LEVEL
TREES ARE CALCULATED AT MATURE HEIGHT IN HIGH SHRINKAGE SOIL
USING NHBC STANDARDS (CHAPTER 4.2) THEREFORE INVERTS MAY
BE HIGHER THAN STATED.
ALL EXCAVATIONS TO BE CHECKED BY BUILDING INSPECTOR
PRIOR TO POURING CONCRETE
TREE SPECIES AND POSITIONS TO BE CHECKED ON SITE PRIOR TO COMMENCEMENT
AND AGREED WITH THE BUILDING INSPECTOR

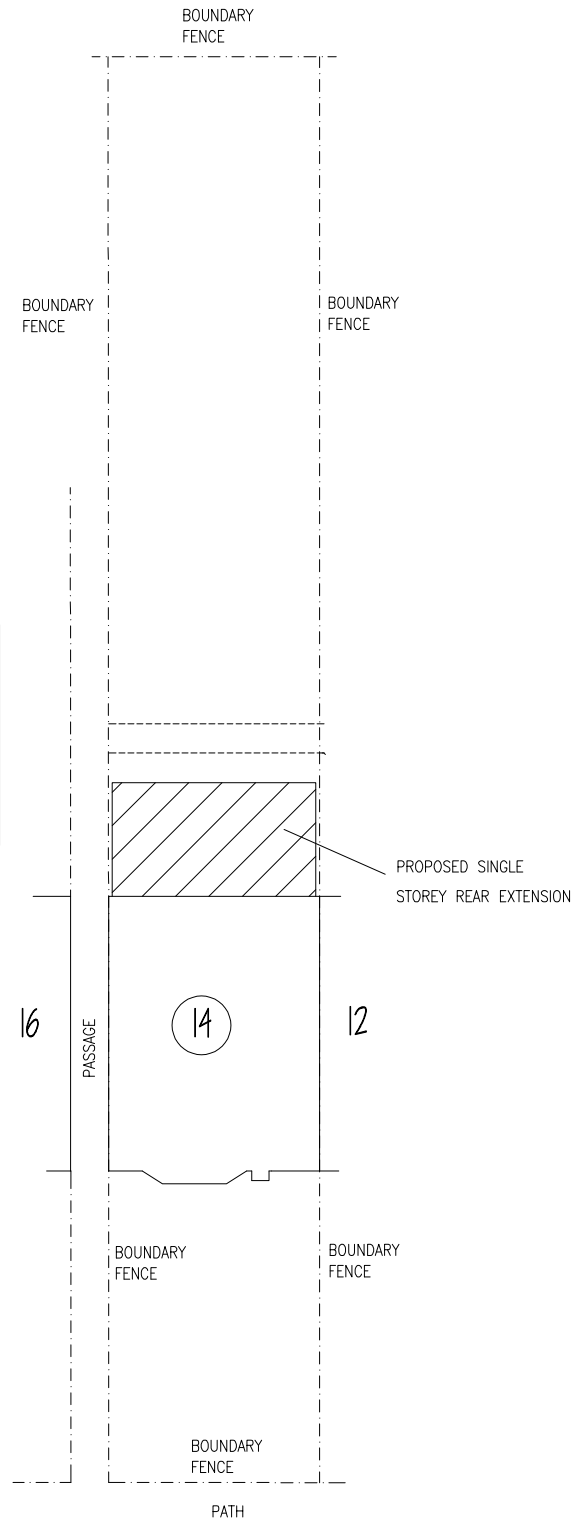

WILTON ROAD



SITE PLAN
1:200