



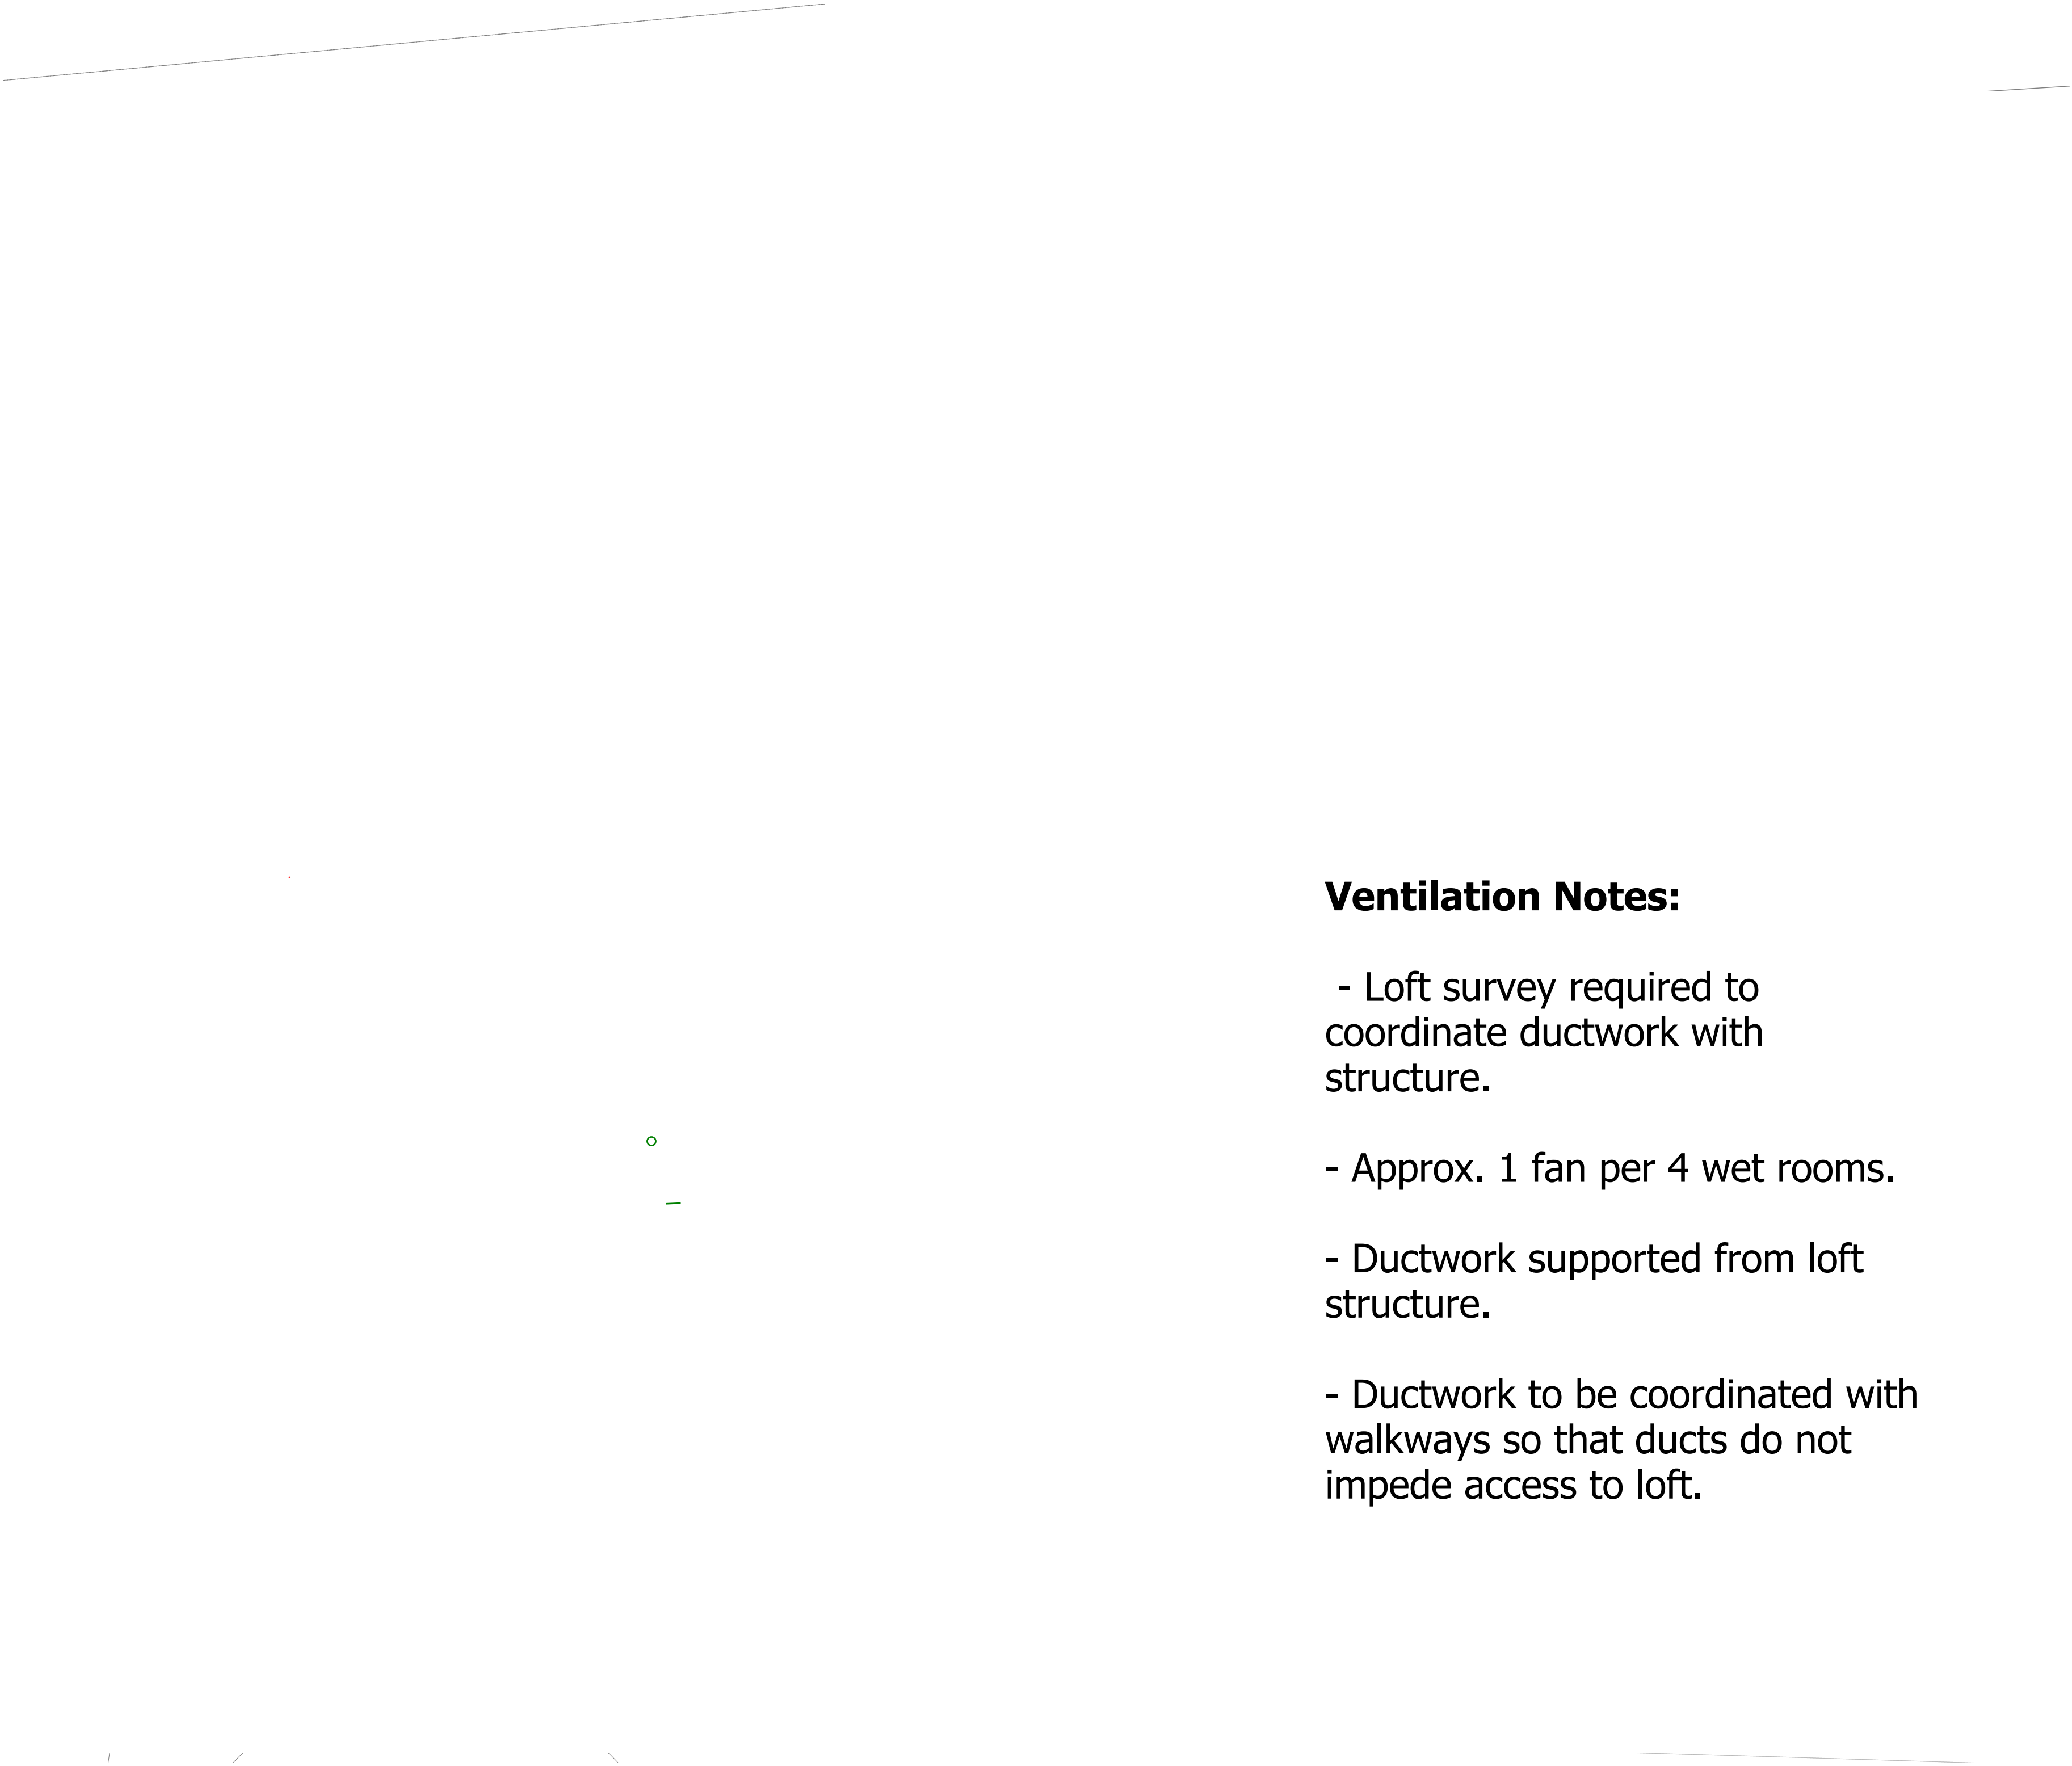

Ventilation Notes:

- Loft survey required to coordinate ductwork with structure.
- Approx. 1 fan per 4 wet rooms.
- Ductwork supported from loft structure.
- Ductwork to be coordinated with walkways so that ducts do not impede access to loft.

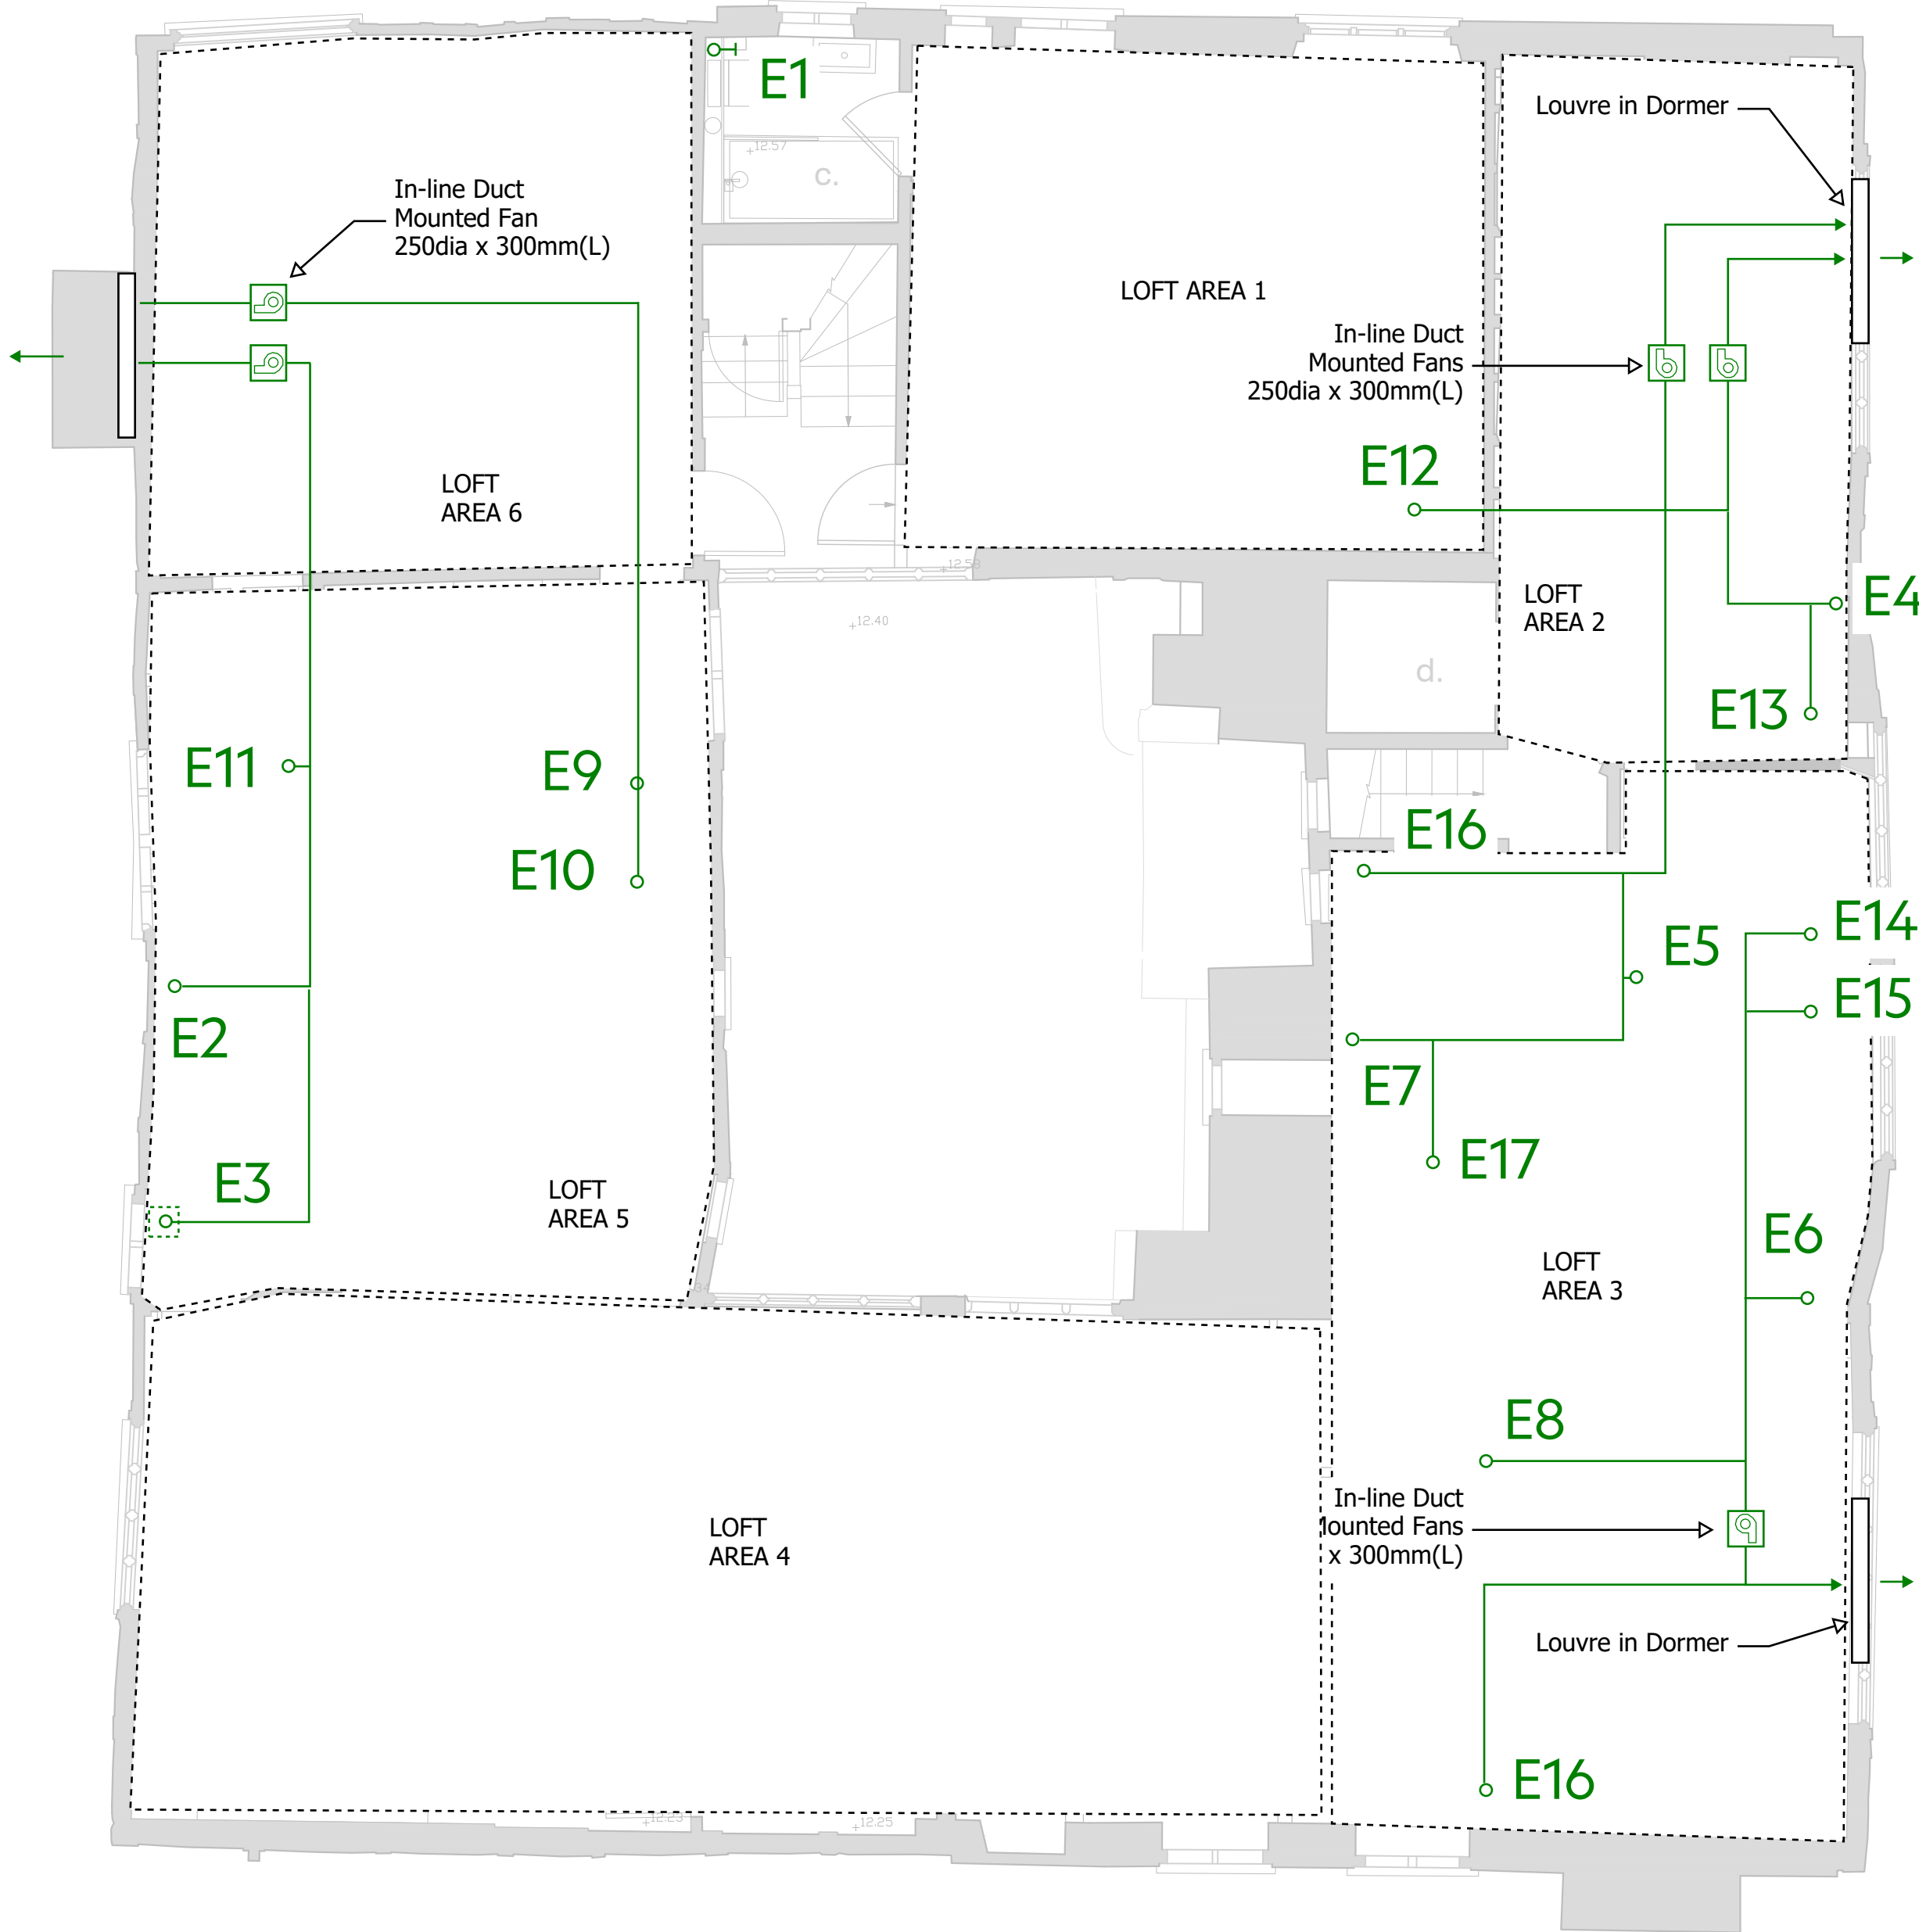

Loft Level

Passive // Mechanical Sustainability and Engineering	Project: The Biggin	Project Number: 1002	Status: For Information		
	Sketch Title: Ventilation Layout - Loft	Sketch Number: TB-SK-MEP-PL-13	Date: 23/02/25	Initials: JG	Revision: P1