


ABOVE GROUND DRAINAGE
SCALE 1:20

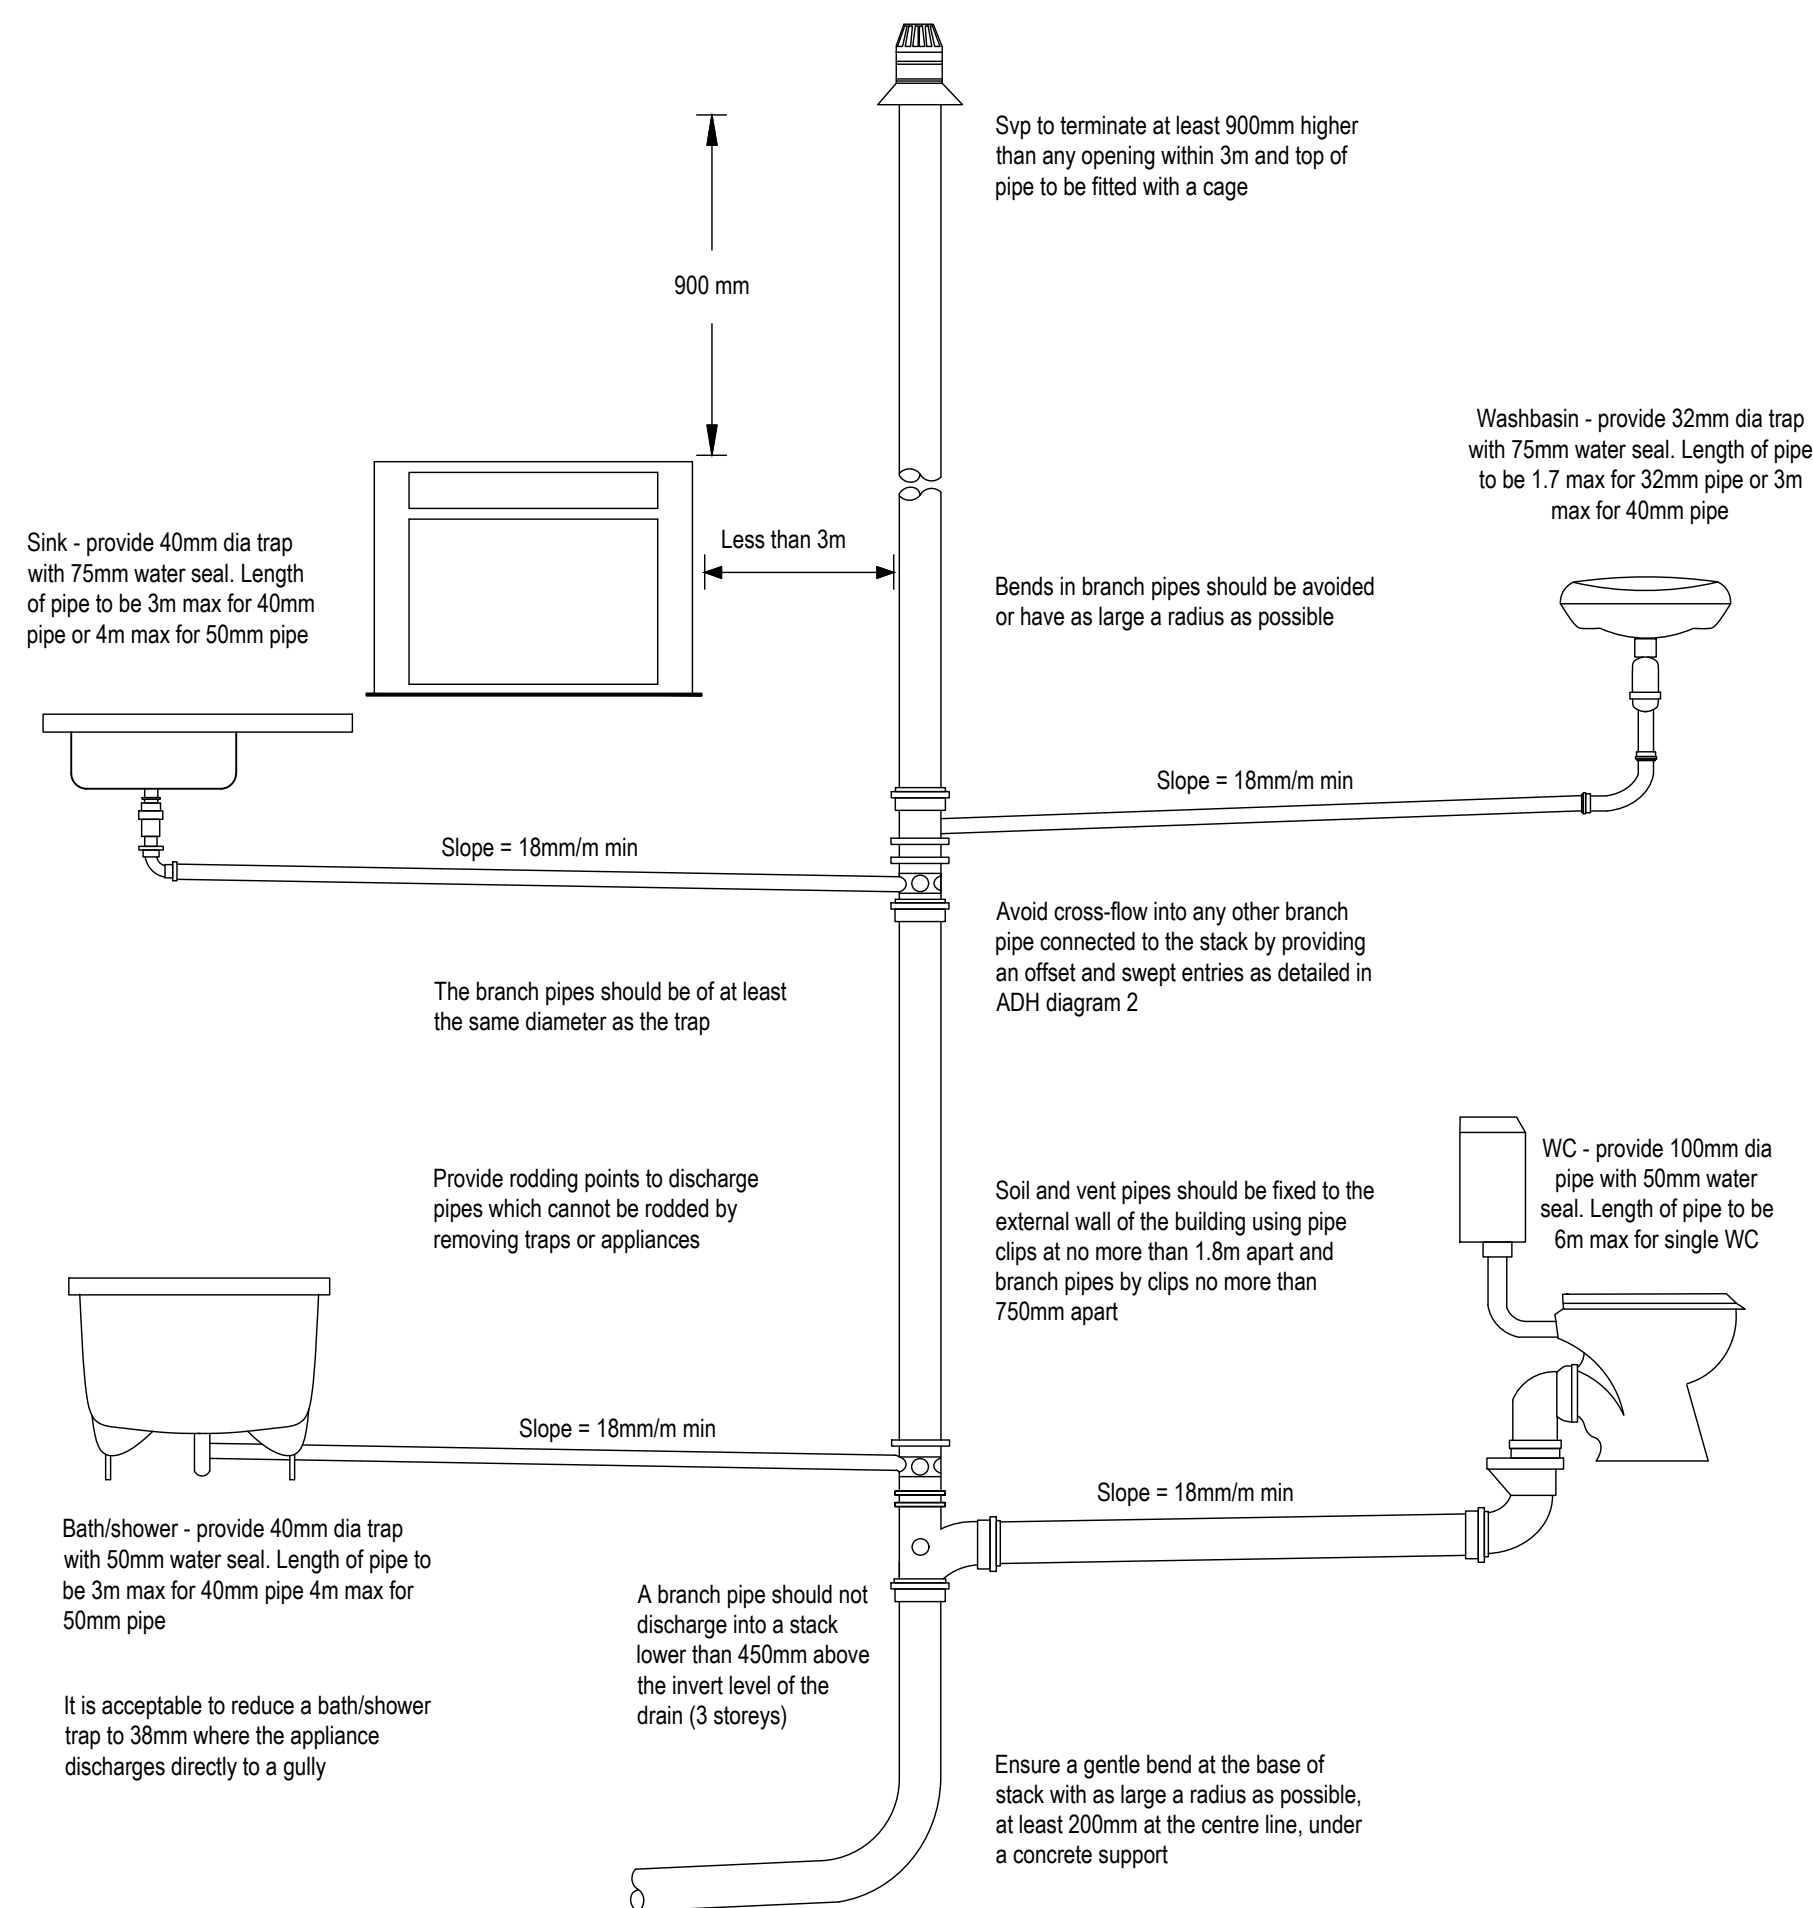

ABOVE GROUND DRAINAGE

All new above ground drainage and plumbing to comply with BS EN 12056-2:2000 for sanitary pipework. All drainage to be in accordance with Part H of the Building Regulations. Wastes to have 75mm deep anti vac bottle traps and rodding eyes to be provided at changes of direction.

Size of wastes pipes and max length of branch connections (if max length is exceeded then anti vacuum traps to be used)

- Wash basin - 1.7m for 32mm pipe 4m for 40mm pipe
- Bath/shower - 3m for 40mm pipe 4m for 50mm pipe
- W/C - 6m for 100mm pipe for single WC

All branch pipes to connect to 110mm soil and vent pipe terminating min 900mm above any openings within 3m, or to 110mm upvc soil pipe with accessible internal air admittance valve complying with BS EN 12380, placed at a height so that the outlet is above the trap of the highest fitting. Waste pipes not to connect on to SVP within 200mm of the WC connection. Supply hot and cold water to all fittings as appropriate.

Arkiplan

74 Cardiff Road, CF15 7QE • Enquiries@ArkiPlan.co.uk

Site	Eastcote, Royston Road, Baldock SG7 6QZ	Date	18.02.2026
		Sheet	23-1054 D10 REV 2
		Job	New Extension
		Scale	Not To Scale
Title Number	HD416279	Title	Section Detail Drawings 1:10